




Lindab **Plexus**

Active chilled beam
Installation instructions

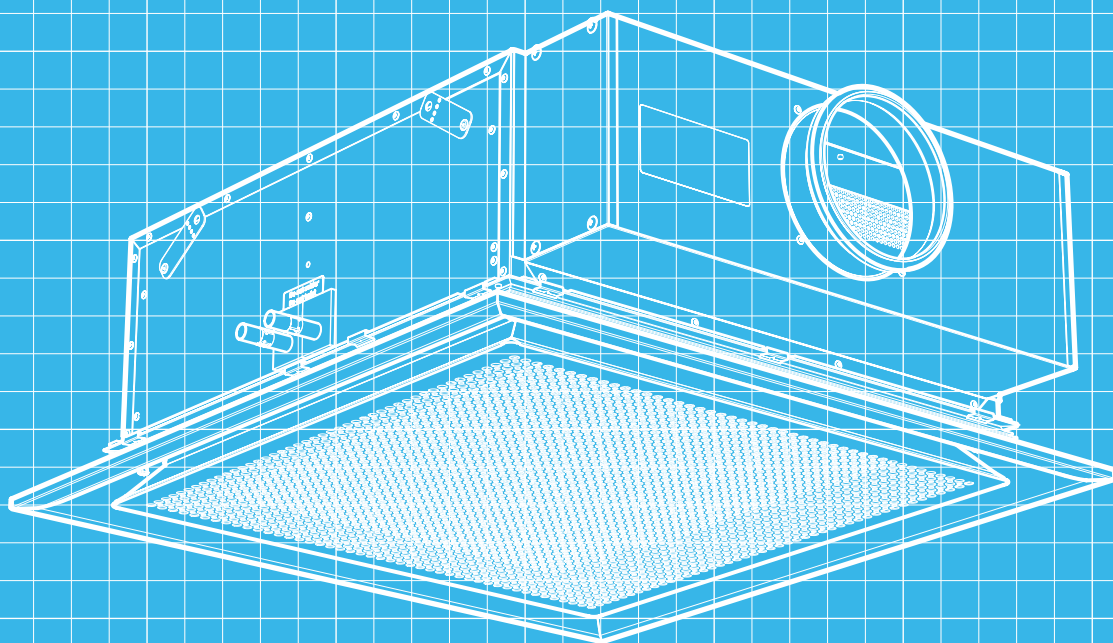

Installation instruction

Plexus

1. Content and symbols

1. Content and symbols	2
1.1 Content	2
1.2 Symbols	3
2. Control of delivery	3
2.1 Before starting	3
2.2 Safe operation	3
2.3 Receipt of goods	3
2.4 Unloading of goods	3
2.5 Handling / Carrying	3
2.6 Tools	4
2.7 Installation	4
2.8 Where to find additional instructions or technical documentation	4
2.9 Cleaning after assembly/before commissioning	4
2.10 Packing, unpacking guideline	5
2.11 Product labelling	6
2.12 Order code	7
2.13 Order code examples	7
2.14 Label	7
2.15 Contents of order	8
2.16 Plus features	8
2.16.1 Inlet faceplates	8
2.16.2 Outlet front grilles	8
2.16.3 Enclosed valves	8
2.16.4 Thermoelectric actuators	8
2.16.5 Integrated Regula components	8
2.16.6 Airguides	8
2.16.7 Heating	8
2.17 Accessories	8
2.17.1 Threaded rod kit (Hangers)	8
2.17.2 Flexible hoses	8
2.17.3 Transformer	8
2.17.4 Tectite fittings	8
3. Product specification	9
3.1 Product description	9
3.2 Dimensions	9
3.3 General structure	10
3.4 Material data	10
3.5 Environmental Declarations	10
3.6 Pressure class	10
3.7 Water quality	10
3.8 Air quality	11
3.9 Capacity test	11
4. Connections	12
4.1 Water connections	12
4.1.1 Before installation	12
4.1.2 Push on valve	13
4.1.3 Compression fitting	13
4.1.4 Flexible hoses	13
4.1.5 Possible connections water cooling (2-pipe, standard)	14
4.1.6 Possible connections water cooling and heating (4-pipe, plus feature)	15
4.1.7 Water pipe dimensions and placement	16
4.2. Air connections	17
4.2.1 Air connection installation	17
4.2.2 Possible connections supply air	17

4.2.3 Possible connections extract air	17
4.3 Possible combination of connections	17
4.4 Electrical connections	18
4.4.1 Regula components on the beam	18
4.4.2 Example 1: Wiring scheme with Regula Connect multi	19
4.4.3 Example 2: Wiring scheme with Regula Connect basic	19
4.4.4 Regula Connect on the beam	20
4.4.5 Regula Secura on the beam	20
4.4.6 Valves and Actuators on the beam (See 2.16.3 and 2.16.4)	20
4.4.7 Regula Combi on/with the beam	20
4.4.8 Thermoelectric actuators (See 2.16.4)	20

5. Installation of product	21
5.1 Handling of product	21
5.2 Adaption to ceiling systems	21
5.2.1 Ceiling systems	21
5.2.2 Adaption to ceiling system	22
5.3 General installation principles	26
5.3.1 Recessed in suspended T-bar ceiling	26
5.3.2 Exposed, sealed to the ceiling	26
5.3.3 Exposed, free hanging	26
5.3.4 Free hanging above perforated or eggcrate ceiling	26
5.3.5 Recessed in suspended (permanent) ceiling	26
5.3.6 Recessed in suspended (permanent) ceiling without cover flanges	26
5.4 Preparation for installation on the product	27
5.5 Basics steps of installing the product	27

6. Adjustment and commissioning	29
6.1 Airflow and pressure	29
6.1.1 Jet cone adjustment pins	29
6.1.2 Finding values for JetCone pins	30
6.1.3 Adjusting air flow and pressure with JetCone pins	30
6.2 Adjustment of air distribution profile	31
6.3 Measuring air pressure and calculating the air flow	31
6.3.1 Measuring static nozzle pressure and air pressure	31
6.3.2 Calculating the actual air flow	31
6.3.3 Changing the actual air flow	31
6.3.4 Changing the air distribution profile	31
6.3.5 Plexus pressure / airflow diagram	32
6.4 Water flow rate	33
6.4.1 Pre-setting of valves	33
6.4.2 Balancing strategy	33

7. Maintenance	34
7.1 Remove the outlet front grille	34
7.2 Open inlet faceplate	34
7.3 Opening inspection hatch	34
7.4 Lower battery	35
7.5 Turnable battery	36

8. Accessories	38
-----------------------	-----------

Installation instruction

Plexus

1.2 Symbols



Hot water



Heavy Load - 2 man job -
It is recommended to use
a "lift" for mounting.



Cold water



Hand-pull

2. Control of delivery

2.1 Before starting

Read through the entire installation instruction before commencing installation in order to determine which parts that needs to be performed and in what order to be done.

Lindab is a supplier of complete water products, but we offer also a wide range of accessories which suit perfectly to our water products simplifying your installation work, e.g. different type of hangers, Tektite-couplings, closing valves, thermostatic valves and actuators, flexible hoses, customized regulation components, customized cabling and more. See also the separate document "[Accessories](#)".

Lindab will also provide you with a full ventilation system, with a wide range of Lindab Safe components. See also "Air Duct Systems".

2.2 Safe operation

Beware of sharp edges, especially of the coils. Always wear thin gloves and protective clothing.

All existing safety regulations must be observed when working with Lindab water products. Check the weights of the beams or the panels with the installation instruction before carrying.

2.3 Receipt of goods

Start by checking that the delivery is complete according to the order and that everything listed on the consignment note has been delivered.

Then carry out a review of the products and make sure that nothing was damaged during transportation. If you discover damage that has occurred during delivery, it must be notified immediately.

Lindab is not responsible for costs associated with the replacement of products that have been installed in any way other than shown in these installation instructions.

2.4 Unloading of goods

The beams and panels are normally delivered packed on wooden pallets. Lift the pallets carefully with a fork lift and place them on a dry and plain surface/ground. If the beams are delivered in single boxes, wooden blocks should be placed on the ground at one-metre intervals (or a pallet), before the boxes are been placed to store. Lindabs water products must be stored on a plane surface in a dry and well ventilated place, preferably indoors. If they have to be stored outdoors, protect them with a waterproof cover and store them protected from rain beneath a roof or other until they are fitted.

2.5 Handling / Carrying

The beam or panel must be handled with care, ensuring that it will not be scratched or bended during transportation, preparation and installation.

Always carry the beams or panels piecewise into the building. Keep the product in the package as long as you can.



Never use piping connections or edges to lift them, neither when you unpack them nor when you carry them towards the construction site.

Do not place the product directly on the floor. Use the protective corners from package or other clean means from package to place the product before installation.

Be careful if you must carry a long panel horizontally; if the panels are bended lengthwise, the profiles may be deformed and the piping could be loosen from the panel. When opening the box with a knife, be careful not to damage the product.

Each beam is equipped with protective film to avoid any damage during transportation and handling on building site. The film needs to be removed before commissioning the products.

Installation instruction

Plexus

2.6 Tools

To install the beam, panel or facade unit, the following tools are required.




Knife




Gloves




Shoes with soft soles




Tape measure




Drill machine




Percussion drill



Pencil



Spanner




Crowbar




Tectite tool 12mm
(Order no: 884087)



Tectite tool small 12mm
(Order no: 646881)




Screwdriver




Spirit level



Lindab PC410
(Order no: 103344)



Deburring tool



Bits and drills



Vacuum cleaner



Dust-cleaner

2.7 Installation

It is important to use the correct hangers and the recommended amount for all installation principles. Different possible installation principles are shown in the installation instruction and hangers from Lindab should be used to ensure, that they are intended for the purpose and are safe to use.

Lindab's water products can be ordered, to be adapted to a wide range of different ceiling systems, please check installation instruction to ensure best adaptation.

The Lindab water products should always be installed separately hanged up from the recessed ceiling. The weight of the product should not be covered by the ceiling system.

Use plastic folio or other to protect the product during on site construction continually to keep the products in best condition and avoid any scratches.

2.8 Where to find additional instructions or technical documentation

In the following chapters we will refer to additional technical documents or/and instructions by a certain keyword written as a link.

You can also find relevant related documents with our Lindab Quick selection tool:

1. Visit www.lindab.com
2. Select "documentation finder"
3. [Select product](#)
4. Find relevant document under "Related documents"


2.9 Cleaning after assembly/ before commissioning

Please remember to remove plastic folio and other protection material before commissioning and clean the product before hand over.

Installation instruction

Plexus





2.10 Packing, unpacking guideline

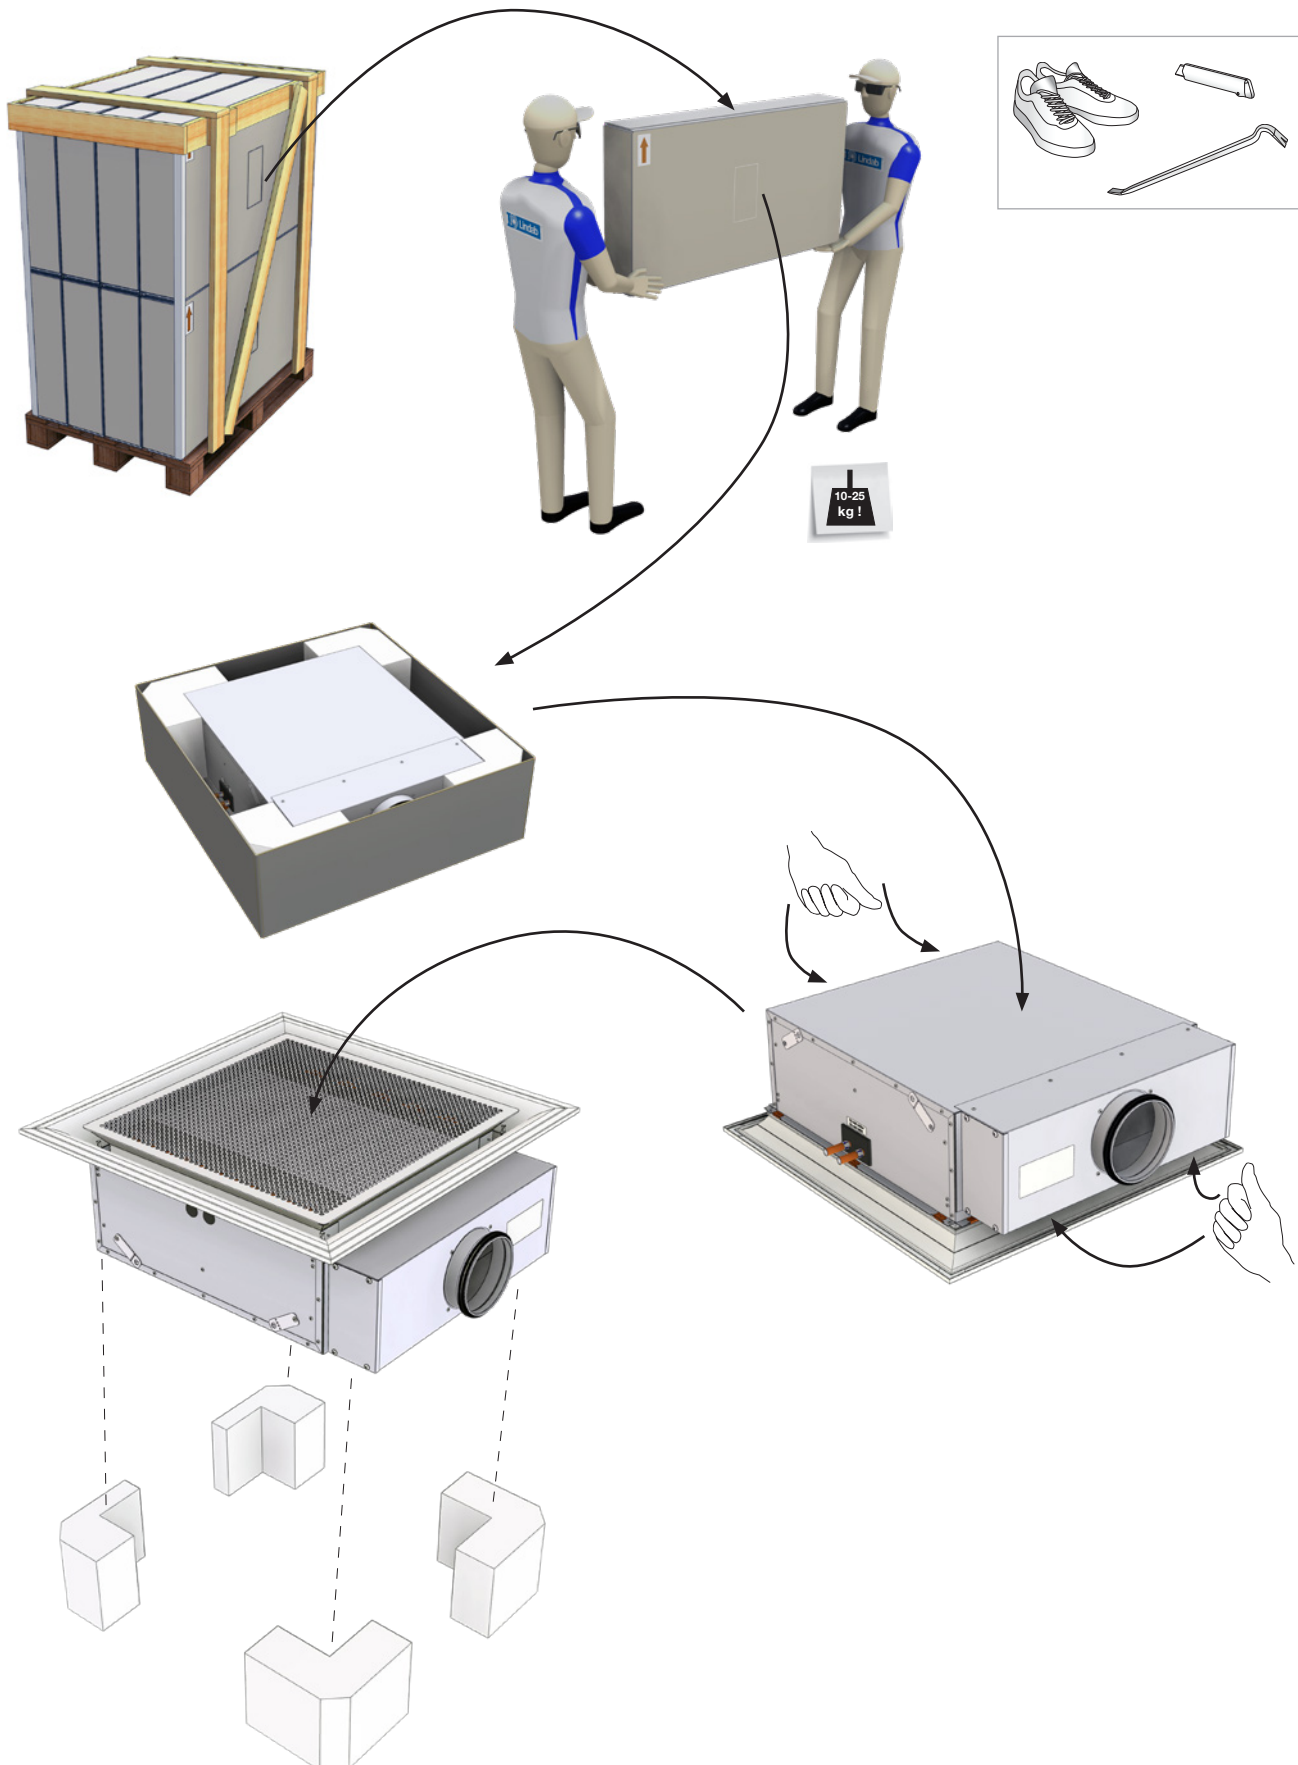

Installation instruction

Plexus

2.11 Product labelling

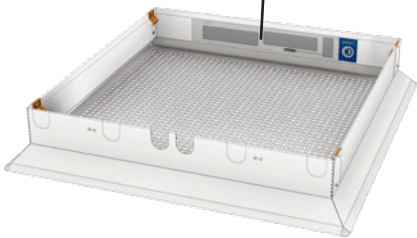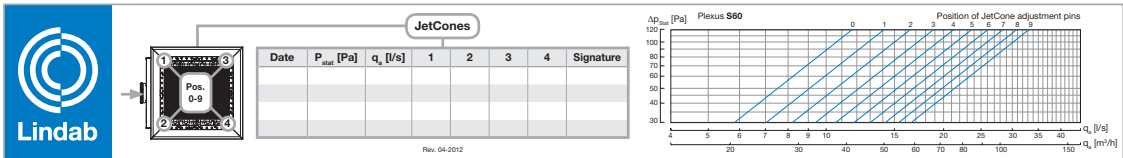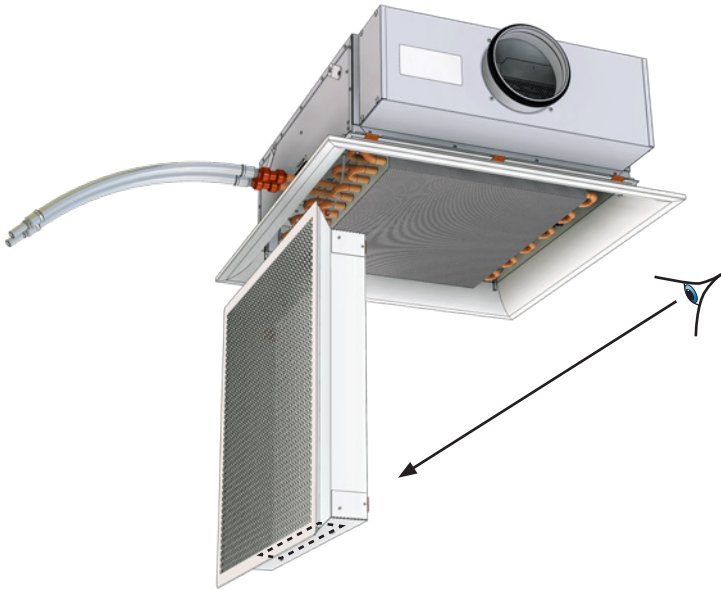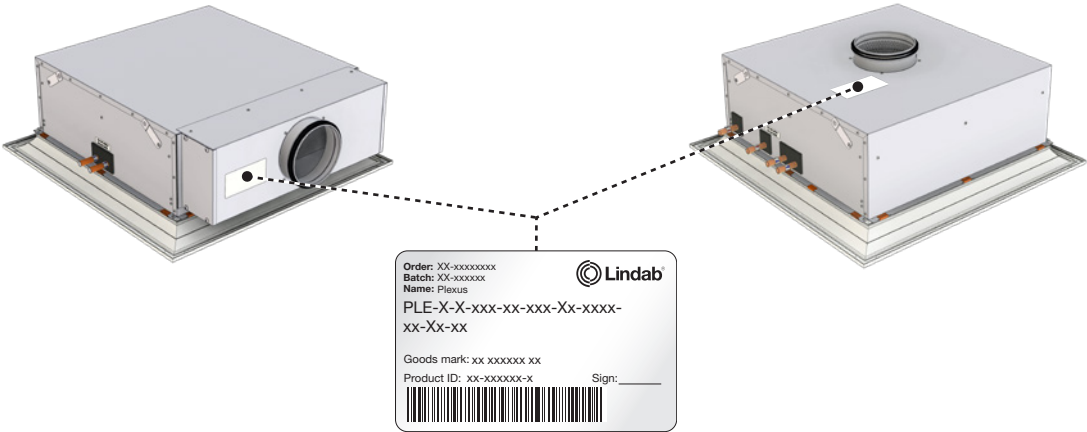


Installation instruction


Plexus

2.12 Order code

Plexus I
Integrated




Plexus F
Free hanging



PLE	I	XX	XXX	12	XXX	XX	XXXX	XX	XX	XX
Type						Connection type				Ceiling adaption
Integrated						A5, A6, B5, B6				01, 03, 04, 05, 06, 07, 08, 09, 10, 11, 14, 21, 31
		Configuration airflow range	Size	Water connection	Air connection		Battery type	Static nozzle pressure	Primary air flow rate	
		S = Standard L = Low M = Medium H = High SA = Standard with steel frame	60 120	Ø12 mm	A: Ø125 / Ø160 mm B: Ø125 / Ø160 mm		1200, 2400 1204, 2004	30-120 Pa	6-110 l/s	 5.2-5.3
Free hanging						A1 B1				
Type						Connection type				
PLE	F	XX	XXX	12	XXX	XX	XXXX	XX	XX	


2.13 Order code examples



→ PLE - I - S - 60 - 12 - 125 - B6 - 2400 - 60 Pa - 24 l/s - 01



PLE - I - H - 120 - 12 - 160 - A5 - 1204 - 80 Pa - 50 l/s - 01



→ PLE - F - S - 60 - 12 - 125 - A1 - 2400 - 60 Pa - 24 l/s - 01

2.14 Label

On the label you will find:

- Order : Order identification number.
- Batch : Batch identification number.
- Product : Product configuration.
- Goods mark : Marking noted on order.
- Product ID : Product number.
- Sign : To be signed when checked and commissioned on site.



Installation instruction

Plexus

2.15 Contents of order

Standard package/order contains:

- Beam
- Plus features (pre-installed in factory)
- 4 pc/beam of copper insets (separate in smaller box)
- Accessories (separate in smaller box)

2.16 Plus features

The plus features offer a wide range of combinations with pre-installed accessories integrated into the product on production site. This reduces the installation time on site.

2.16.1 Inlet faceplates

Not relevant for Plexus

2.16.2 Outlet front grilles

Not relevant for Plexus

2.16.3 Enclosed valves



LinFlow-S, straight valve




LinFlow-A, angled valve

See [LinFlow-A](#) and [LinFlow-S](#) for details.


As the product is very compact, the valves (including the adapter rings and actuators, as specified in the order) are pre-assembled and positioned with adhesive tape near the piping, ready to be connected to the water connections.

2.16.4 Thermoelectric actuators

A-40405
Actuator



APR-40405
Actuator



VA 64
Adapter ring




As described above, the actuators can be pre-installed on the valves at the factory and connected to the integrated Regula Connect card, Regula Secura (according to the respective order).

Go to [Actuators](#) for details. See also [Adapter ring](#).

2.16.5 Integrated Regula components



Regula Combi



Condensation sensor
and Regula Secura



Regula Multi connect card

Go to [Regula](#) for details.

2.16.6 Airguides

Not relevant for Plexus.

2.16.7 Heating

The product can be equipped with an extra water circuit with 12 mm connections in the battery to provide a heating function (4-pipe connection). See the chapter "Zone heating" in the [Plexus data sheet](#).

2.17 Accessories

Here are some general accessories. For full range and order numbers, see separate [Accessories](#) document.

2.17.1 Threaded rod kit (Hangers)



M8 x4 per beam

Go to 5.4 "Preparation for installation on the product" for more details. Order no: See [Accessories](#)

2.17.2 Flexible hoses



Order no: See [Accessories](#)

2.17.3 Transformer



Order no:
See [Transformers](#)

2.17.4 Tectite fittings



Order no: 647690, 884050 and 642623 (12 mm)
see [Accessories](#)

Installation instruction

Plexus

3. Product specification


3.1 Product description

The Plexus beam is a 360° comfort unit and is standardly prepared for ventilation and cooling (2-Pipe connection). It is available in an integrateable (I 60 / I 120) and an exposed version (F 60 / F 120).



3.2 Dimensions

All dimensions in mm.

Plexus I 60

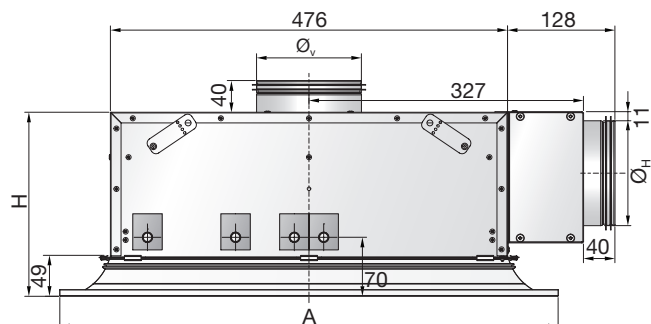

Plexus I 120


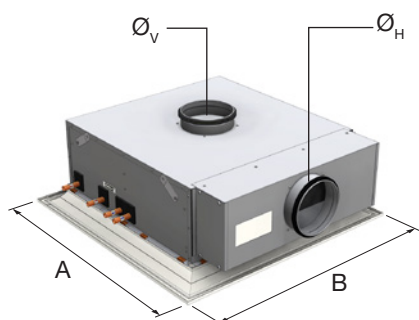
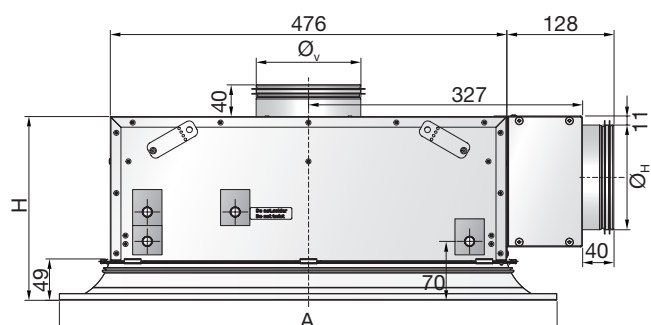


Type	Dimensions [mm]				
	A*	B*	H	Ø _H	Ø _V
I (S/SA) 60	594	594	220	125	125
I (L, M, H) 60	594	594	220	125	160
I (S/SA) 120	594	1194	220	125	160
I (H) 120	594	1194	250	160	N/A

Table 1. Plexus I dimensions.

* Dimensions A and B depend on ceiling system.
See chapter 5.2.1.

Plexus F

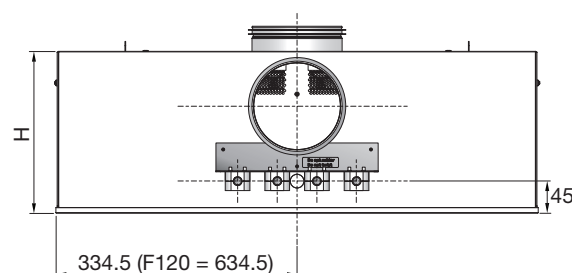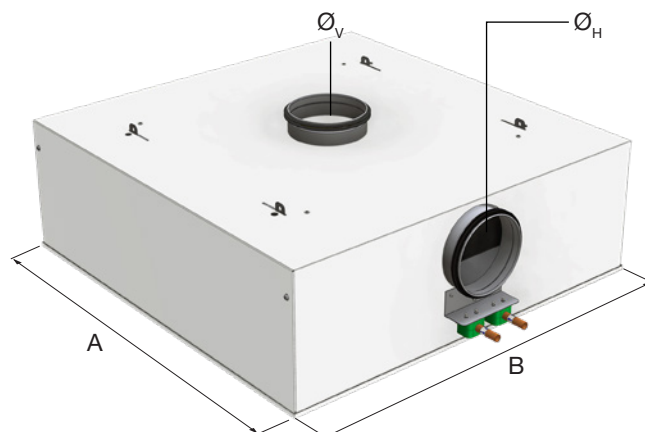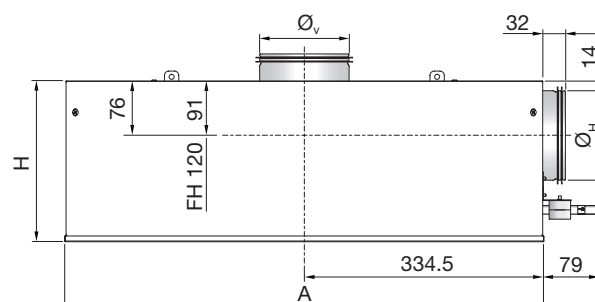


Type	Dimensions [mm]				
	A	B	H	Ø _H	Ø _V
F (S) 60	669	669	225	125	125
F (L, M, H) 60	669	669	225	125	160
F S 120	669	1269	225	125	160
F H 120	669	1269	255	160	N/A

Table 2. Plexus F dimensions.

Installation instruction

Plexus

3.3 General structure

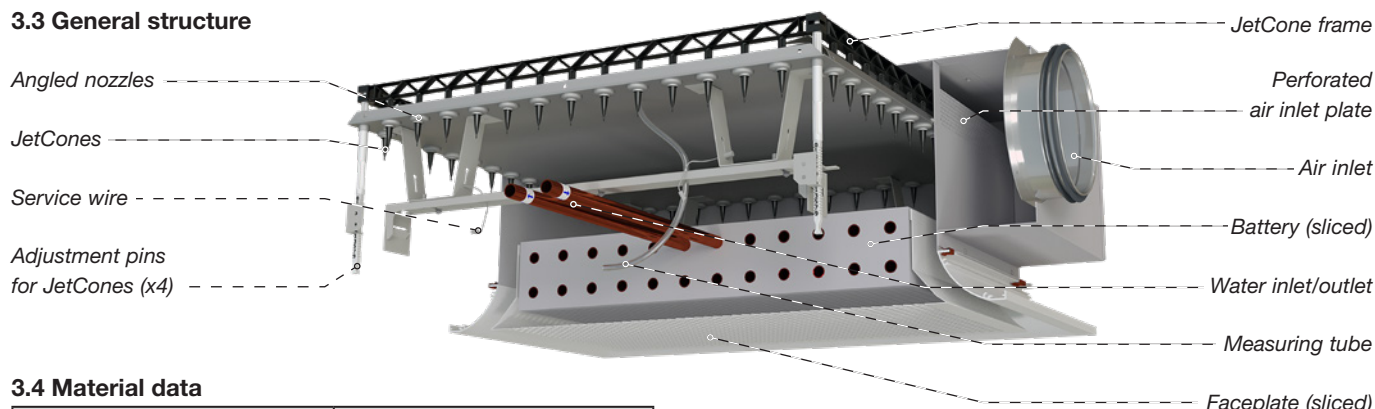

3.4 Material data

Type	Plexus
Copper pipes, quality	EN-12735-2 CU-DHP
Pressure class	PN10

Table 3. Material data.

Type	Function	Battery type CC HH	Water content [l]		
			Cooling	Heating	Total
I-60 / F-60	2-pipe	24 00			1.2
I-60 / F-60	4-pipe	20 04	1.0	0.2	1.2
I-120 / IH-120 / F-120	2-pipe	12 00			1.3
I-120 / IH-120 / F-120	4-pipe	12 04	1.3	0.4	1.7

Table 4. Water content.

Type	Function	Dry weight [kg]
		Total
I-60	2-pipe	11.6
	4-pipe	
F-60	2-pipe	17.2
	4-pipe	
I-120	2-pipe	18.6
	4-pipe	20
F-120	2-pipe	28.9
	4-pipe	30.3
IH-120	2-pipe	19.6
	4-pipe	21
FH-120	2-pipe	29.9
	4-pipe	31.3

Table 5. Weight.

3.5 Environmental Declarations

Please follow the links below.

- [Building product declaration](#)
- [Declaration of conformity](#)
- [Eurovent certificate](#)

3.6 Pressure Class

The waterborne products in Lindab, active chilled beams (battery products), passive chilled beams (battery and strips products), facade units (battery) and radiant panels (strips and panels) are produced according to pressure class PN10 according to EN 1333: 2006.

This means the maximal working pressure for the products at a water temperature of 20°C must not exceed 10 bar.

3.7 Water quality

Lindab in general recommends the water treatment and quality to be according to:

VDI 2035-2: 2009 "Prevention of damage in water heating installations Water-side corrosion".

and

VDI/BTGA 6044: 2023 "Prevention of damage in cold and cooling water circuits".

- Water systems must be designed as corrosion sealed installations. However, the planning data must be documented in a system logbook (e. g. according to **VDI 2035 part 2**, Annex C).
- The water preparation and maintenance for the water system must be handled by a specialist.
- To prevent corrosion, the water system must be airtight, and a constant input of oxygen must be avoided. In addition, scheduled maintenance and, when necessary, repairs are important corrosion protective measures (all to be documented in the system logbook).
- Before commissioning, the water system installations must be flushed thoroughly (it has proven to be necessary to consider the flushing of the system in the planning process already) with filling or make up water (see **EN 14336**) to remove particulate foreign matter from circulating water (e. g. corrosion products, dirt, microorganism, welding/soldering residues, substances entered during tool damage or others). Detailed information on this is formulated in **BTGA Rule 3.002**.

Installation instruction

Plexus

- The water system must be filled (and re-filled) with clean drinking water that complies with the “**EC directive 98/83/EC**”.

Appropriate measures must be undertaken and reported (system logbook) to ensure that the guide values are kept according to:

VDI 2035 Part 2: 2009, for heating water systems

Parameter	Unit	Low-saline	Saline
Electrical conductivity at 25 °C	µS/cm	< 100	100 - 1500
Appearance		Free of sedimentary substances	
pH-value at 25 °C		8.2 - 10.0	
Oxygen	mg/l	< 0.1	< 0.02

Table 6. Guide values for the heating water.

and

VDI/BTGA 6044 Part 4: 2023, for cooling water systems.

Parameter	Unit	Value
Electrical conductivity	µS/cm	10.....1500
Appearance		Clear, free of sedimentary substances
pH-value		8.2 - 10.0
Total hardness	mol/m³	< 1.5
Iron	g/m³	< 0.5
Copper, zinc, aluminium	g/m³	< 0.2
TOC of the untreated water	g/m³	< 25
Oxygen	mg/l	< 0.1

Table 7 Reference value table for filling, make-up and circulating cooling water.

- The water in the system must be always oxygen free, meaning an oxygen content of 0.1 mg/l in all parts of a water system must not be exceeded (**VDI 6044**) to prevent corrosion.
- The pH value of water must be between approximately 8.2 and 10.0 at 25 °C.
- The water velocities in the water system should not exceed 1 m/s to avoid corrosion and should be kept as close to the nominal flow as possible to minimize noise and optimize the energy yield.
- Lindab recommends to use in-line strainers, and filters (e. g. according to table 3 **VDI/BTGA 6044 Part 4: 2023**) in sensitive parts of the water system to remove dirt particles from the water.
This can especially be fundamentally recommended in renovation of existing water systems.

- It can be further recommended (**VDI/BTGA 6044 Part 4: 2023**) to install a sensor-supported continuous monitoring of the circulation water and/or system for water treatment or purification in the bypass flow.
- If the water contains any additive inhibitor, then it must be appropriate to use with copper and solder and all other materials involved. If in doubt, do not hesitate to contact Lindab for further advice.

Lindab reserves the right not to accept any claims related to leakage or corrosion in our products, if the system water quality of the filling water and the changed conditions during the entire period of operation have not been recorded in a system logbook or similar document, and/or one of the above recommendations has not been followed correctly.

3.8 Air quality

Primary supply air have to be clean, dry and filtered before reaching the beam.

3.9 Capacity test

Lindabs active chilled beams are Eurovent-certified and tested according to EN-15116.

Please visit Plexus on www.lindQST.com and see Eurovent for more details.



Installation instruction

Plexus

4. Connections

4.1. Water connections

Flow indication arrows are shown on the inlet and return pipes in order to assist the installer.


If the control valves have been ordered separately, a special direction of the flow must be upheld to ensure correct flow through the control valve. Please note the flow direction indicator on the valve to insure correct installation in relation to the desired flow. When connecting a panel or a beam with the piping system either a push-on fitting or a compression coupling should be used. Lindab have tested and recommends John Guest push on fittings as well as push-on fittings from Tectite (available as accessory. See [Accessories](#)).

To avoid sound being transported over the beam, we recommend to use our flexible hoses between the piping and the beam connections. See [Accessories](#).




NB! Every control valve can create sound when it is installed directly connected to the water in- or outlet (or into the piping in close distance to the in- or outlet of the water product). To avoid unwanted sound generation we recommend to always use a Lindab control valve [LinFlow-A](#) (angled) or [LinFlow-S](#) (straight) and calculate the beam with the valve in [LindQSTwaterborne calculator](#).

4.1.1 Before installation

- Notice! The connection pipes are internally soft-welded, therefore it is not allowed to solder the beam to the pipes. For other than Lindab fittings and valves, please consult the installation guide for the specific fitting for further details on proper installation.
- Both inlet- and return pipes are covered by a plastic or rubber protection cover, which must be removed before installation.

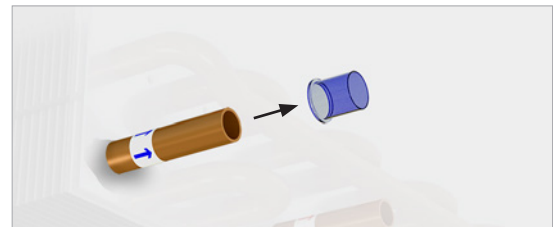

- After removing the protection cover, make sure that the pipe is intact and undamaged, especially at the pipe end, as even small dents and scratches potentially pose a risk of leakage in the system.
- Eventually deburr the pipe ends on the inside and the outside, using a deburring tool before installation.

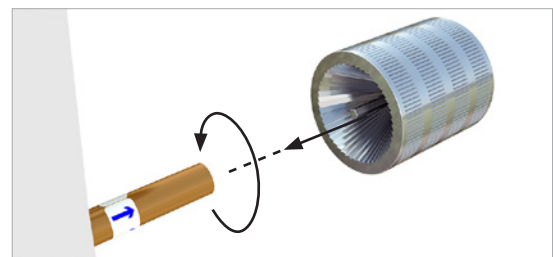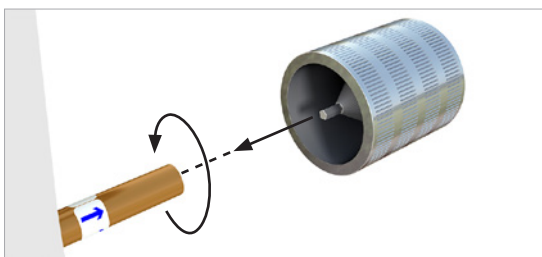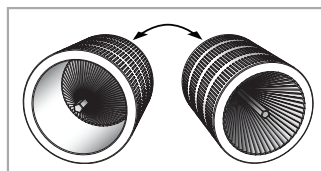


- Always remember to do a pressure test after assembly of the pipe work.

Installation instruction

Plexus

4.1.2 Push-on valve

- Mount a push-on valve to the pipe. Make sure the valve has the correct flow direction (see indication arrow on the valve) and that you have the correct valve, when integrated valve has been chosen (see indication on valve or follow cabelling to Regula Connect card). Cooper inserts aren't required !
- Please refer to the suppliers manual.



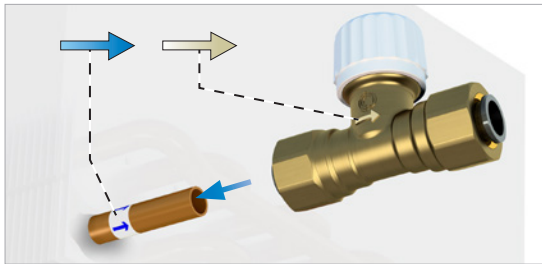


4.1.3 Compression fitting

- While mounting a compression fitting, the pipe will be exposed to a big amount of force, creating a risk of crushing the pipe. To ensure that the pipe won't be crushed when mounting the compression fitting, a copper insert must be inserted into the pipe (always part of the delivery).
- The copper insert should be placed inside the pipe on the beam. Always support the copper pipe coil when inserting the copper insert into position.
- Mount a compression coupling and/or a valve to the pipe. Don't stress the nut too much, since this may crush the pipe.
- Please refer to the suppliers manual.

4.1.4 Flexible hoses

- Our flexible hoses with straight ends can be used with both push-on and compression fitting.
- We recommend to use our flexible hoses with push-on fittings, for easier and faster mounting.
- For the connection to an enclosed valve with integrated push on coupling a flexible hose with straight end (male) or with push on (female) and a short copper pipe can be used.
- Please refer to the suppliers manual.

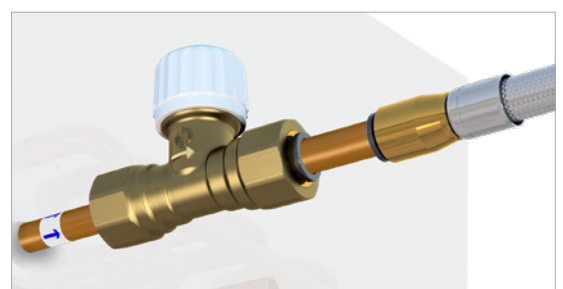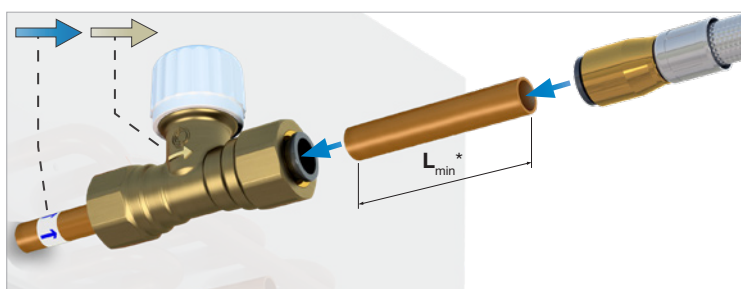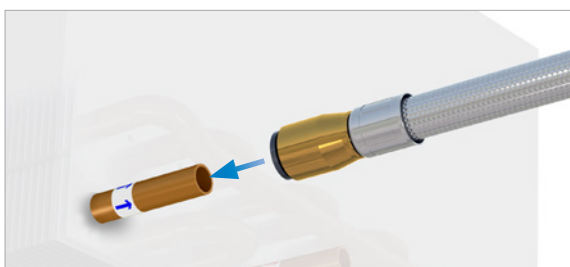

* $L_{min} = 70 \text{ mm}$ (to ensure you can open the couplings again).

Lindab flexible hoses are available with straight end (male) for direct connection to Lindab valves also.

Installation instruction

Plexus

4.1.5 Possible connections water cooling or heating (2-pipe, standard)


All the Plexus active chilled beams are in the standard version equipped with a so called “2-pipe connection” and contain one water circuit (cooling or heating).

The dimension for all water pipe connections are $\varnothing = 12$ mm.

Cooling or heating (standard)


Plexus I-60

A5, A6, B5, B6

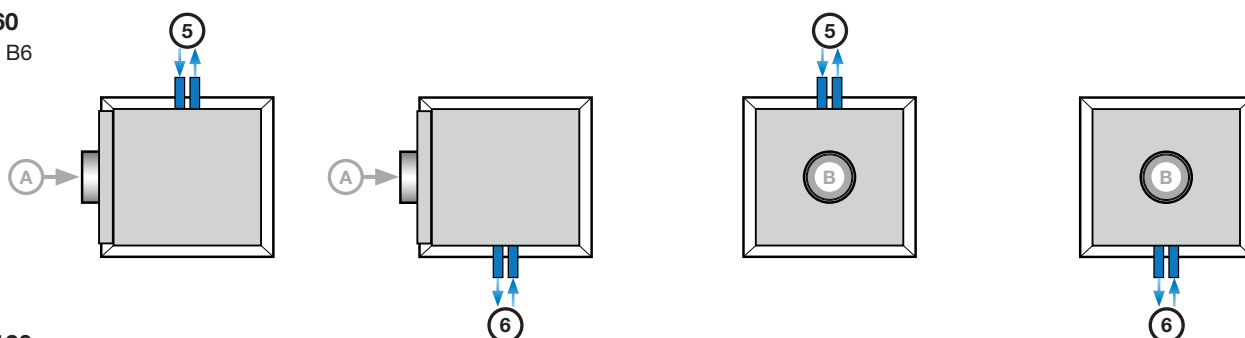


Plexus I-120

A5, A6, B5, B6

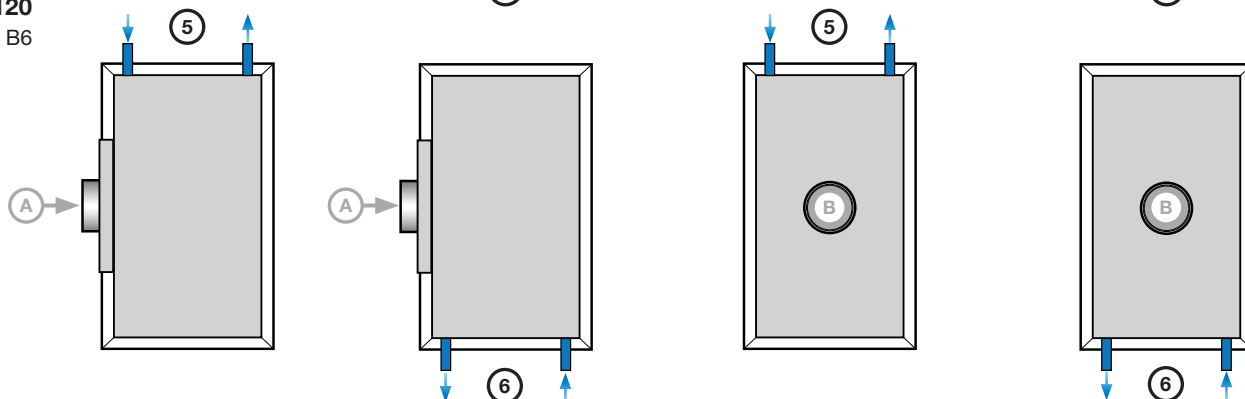

Plexus IH-120

A5, A6

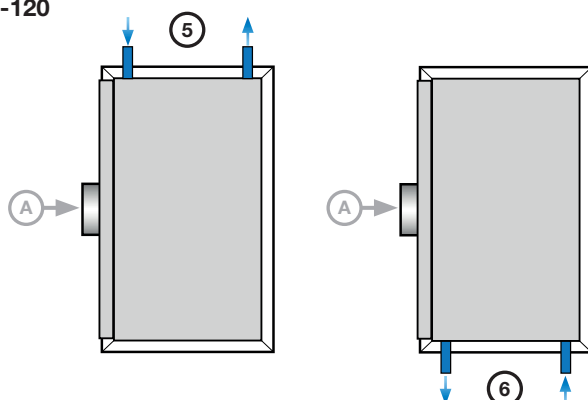


Plexus F-60

A1, B1




Plexus F-120 / FH-120

A1



Plexus F-120

B1



Possible 2-pipe water connections.

Installation instruction

Plexus

4.1.6 Possible connections water cooling and heating (4-pipe, Plus feature)


All Plexus' can have a 4-pipe water connection (plus feature), which beside the cooling circuit also includes a heating circuit.

The dimension for all water pipe connections are $\varnothing = 12$ mm.

Cooling and heating


Plexus I-60

A5, A6, B5, B6

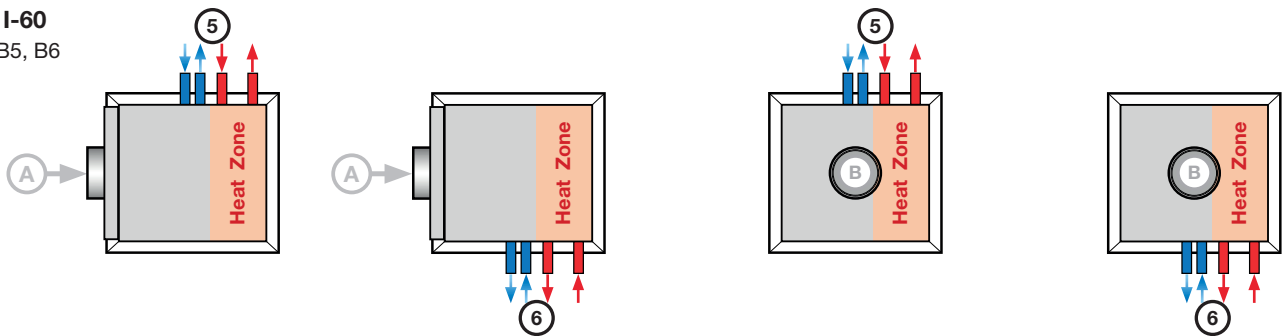


Plexus I-120

A5, A6, B5, B6

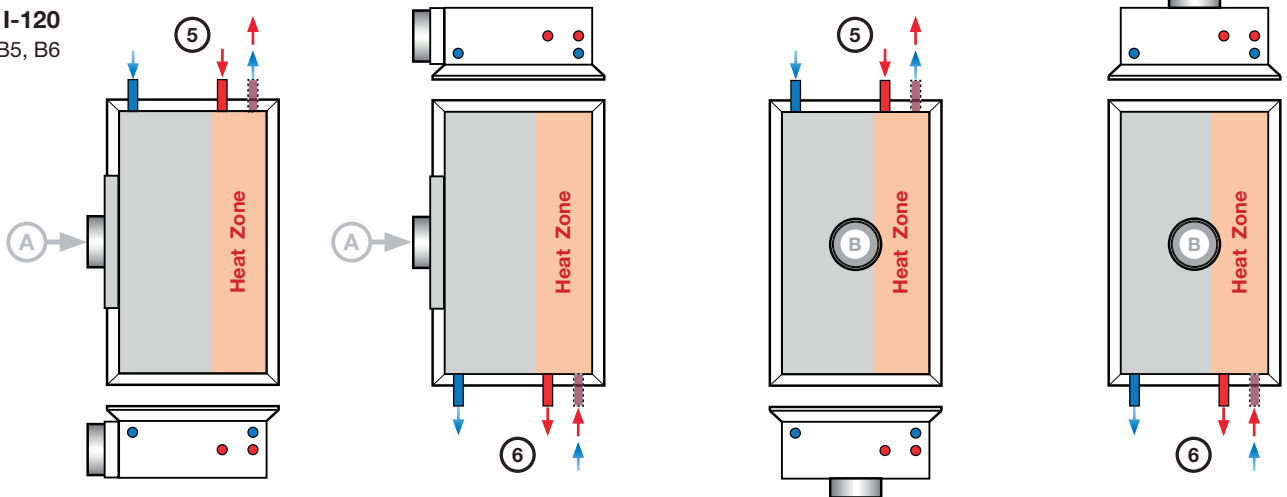


Plexus IH-120

A5, A6

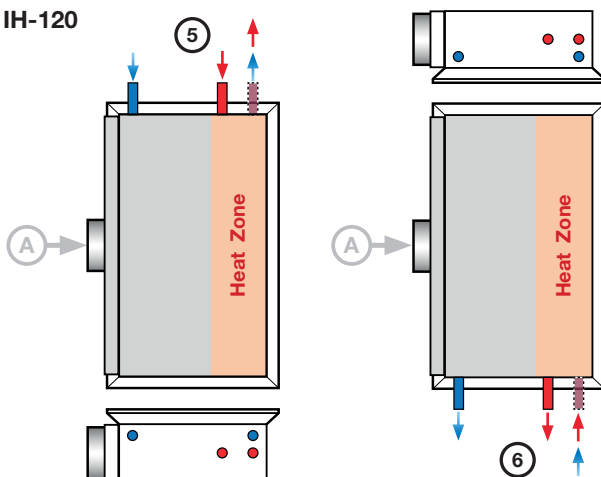


Plexus F-60

A1, B1

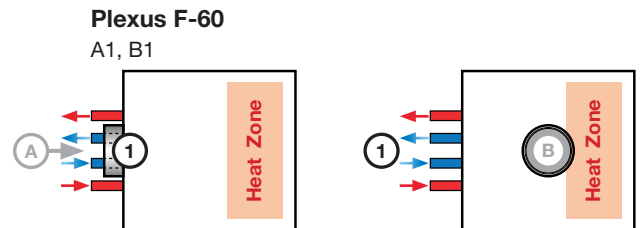


Plexus F-120 / FH-120

A1

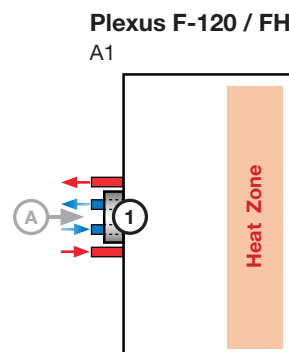

Plexus F-120

B1

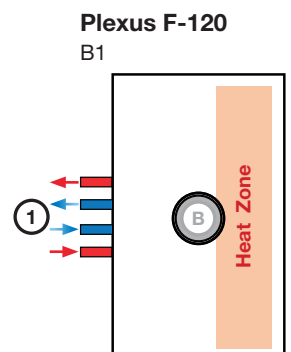


Possible 4-pipe water connections.

Installation instruction

Plexus



4.1.7 Water pipe dimensions and placement

Plexus I 60


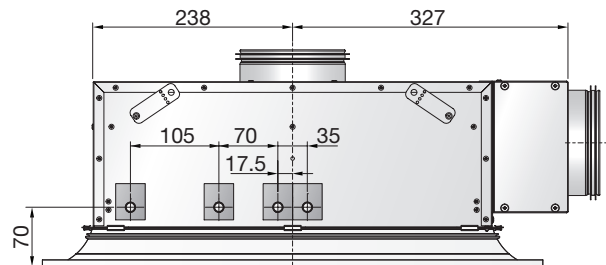


I-60: 2-pipe battery (standard).


Plexus I 120

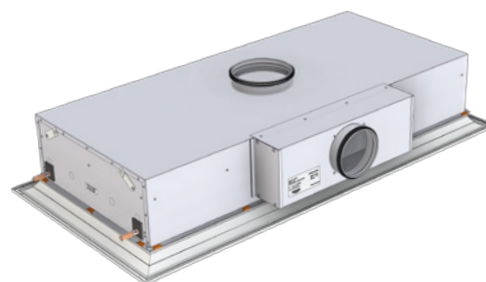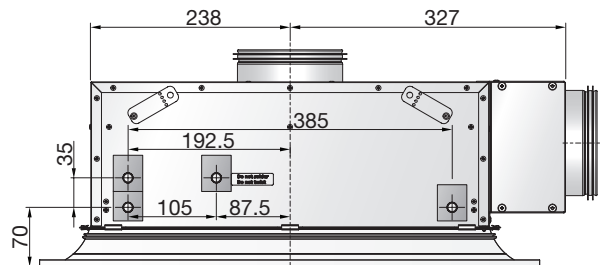

I-120: 2-pipe battery (standard).

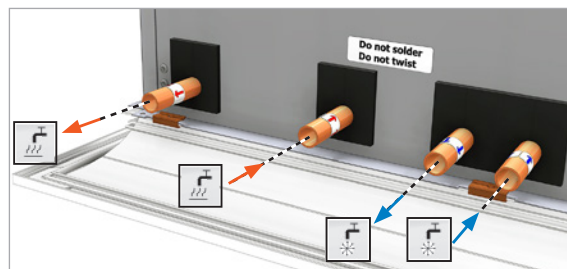


I-60: 4-pipe battery (plus-feature).

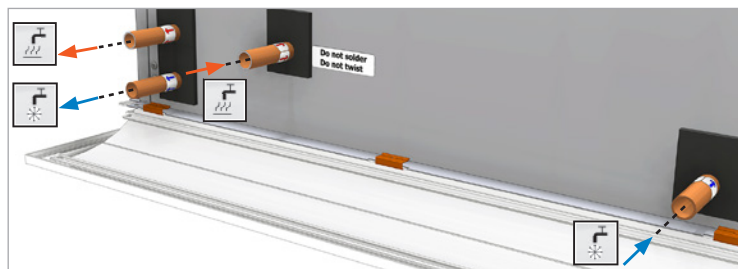


I-120: 4-pipe battery (plus-feature).

Plexus F 60

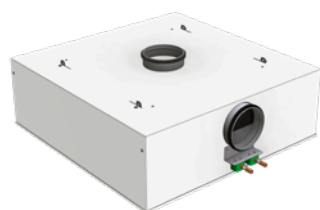


F-60: 2-pipe battery (standard).

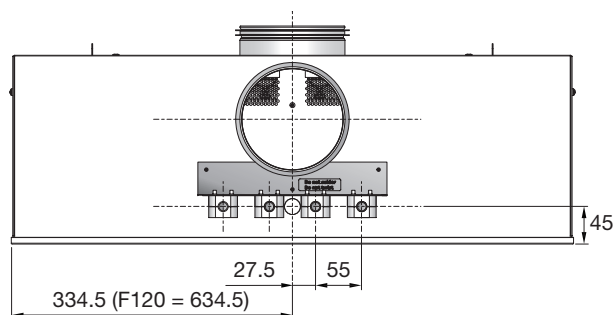



Plexus F 120



F-120: 2-pipe battery (standard).

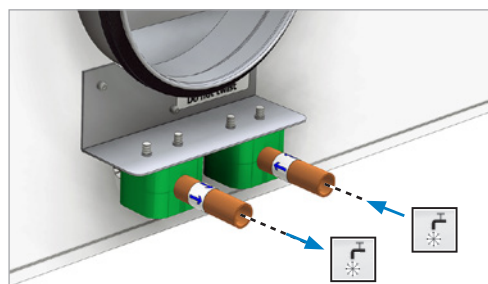

F model: 2-pipe battery (standard).

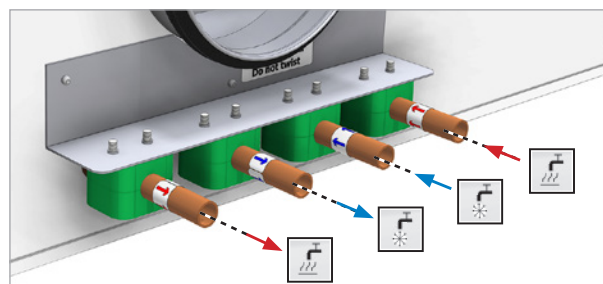

F model: 4-pipe battery (plus-feature).

Installation instruction

Plexus

4.2 Air connections

4.2.1 Air connection installation

The primary air supply must be connected with instructions from a ventilation specialist. Lindab's chilled beams can beneficially be used together with Lindab's Safe® duct systems.

We recommend a flexible duct connection, like Lindab DRATMFU-125/160, to balance out different installation heights or directions between connection and duct and avoid sound will be diverted from piping system to the ceiling.

4.2.2 Possible connections supply air


Plexus I-60

A: Ø125 mm.

Alternatively:

B: S Ø125 mm,

B: L/M/H Ø160 mm.

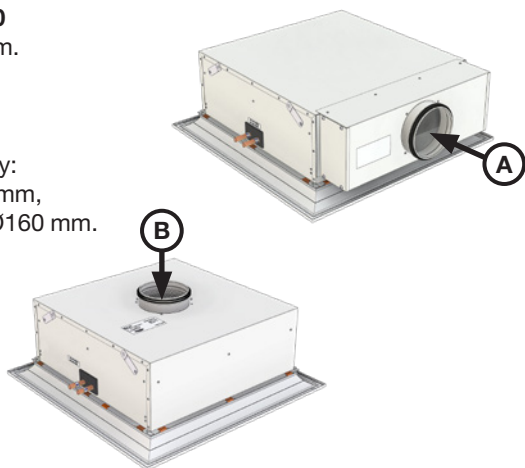


Plexus I-120

A: Ø125 mm.

Alternatively:

B: Ø160 mm.

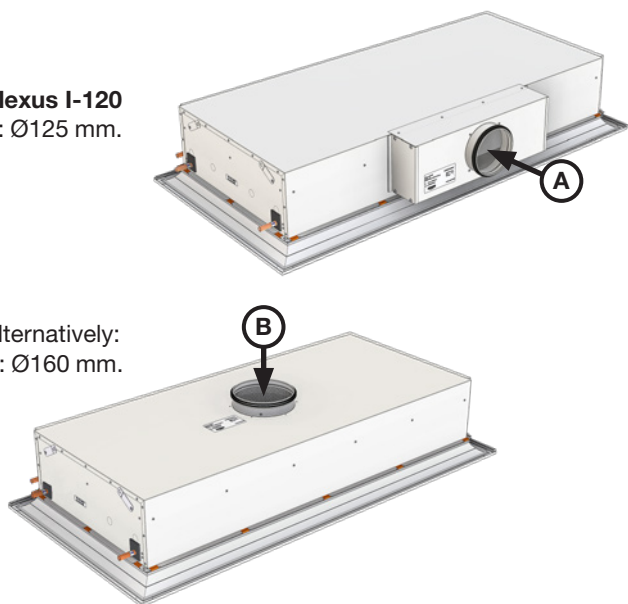

Plexus IH-120

A: Ø160 mm.

B: Not possible.




Plexus F-60

A: Ø125 mm.

Alternatively:

B: S Ø125 mm.

B: L/M/H Ø160 mm.

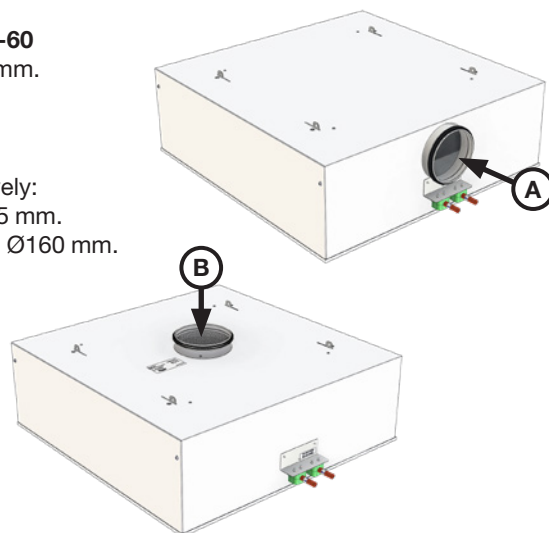

Plexus F-120

A: Ø125 mm,


Plexus FH-120

A: Ø160 mm.

Alternatively:

B: Ø160 mm.

Plexus FH-120, B: Not possible.

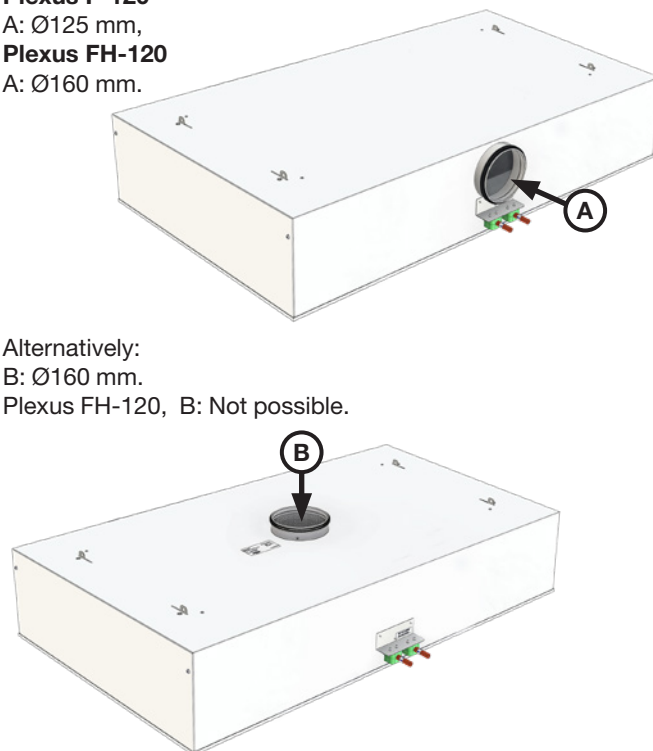

4.2.3 Possible connections extract air

Not relevant for Plexus

4.3 Possible combination of connections

See 4.1.5 and 4.1.6 for all possible connections.

Installation instruction


Plexus

4.4 Electrical connections

Electrical connections on the beam are only necessary, when plus features are chosen and thanks to the pre-fabrication it is as easy as “plug and play”. The components are always installed near the water-connection at the end of the beam.

For further information, see [Regula](#).

4.4.1 Regula components on the beam

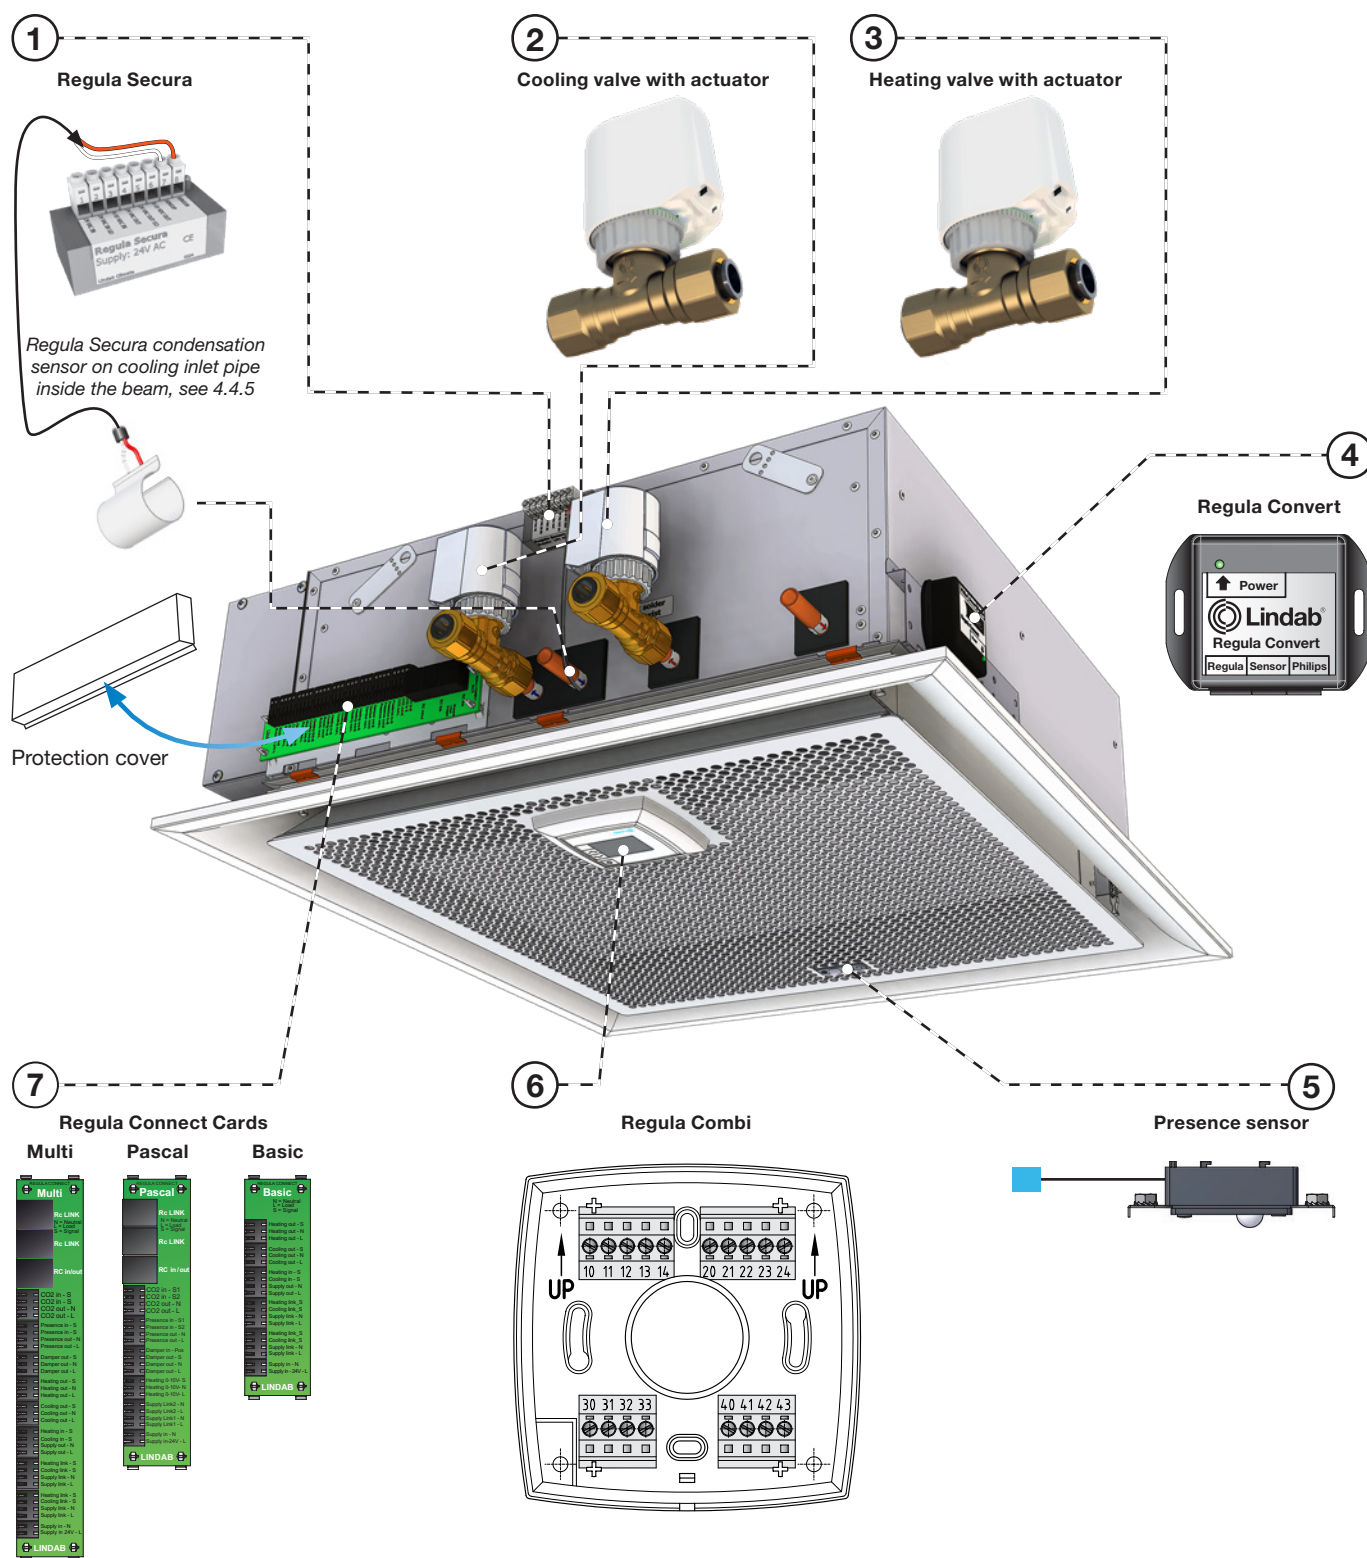


(with protection covers, optional).

Installation instruction


Plexus

4.4.2 Example 1: Wiring scheme with Regula Connect multi

Please visit www.lindQST.com and check out the
“[Wiring scheme configurator](#)” for your set-up.

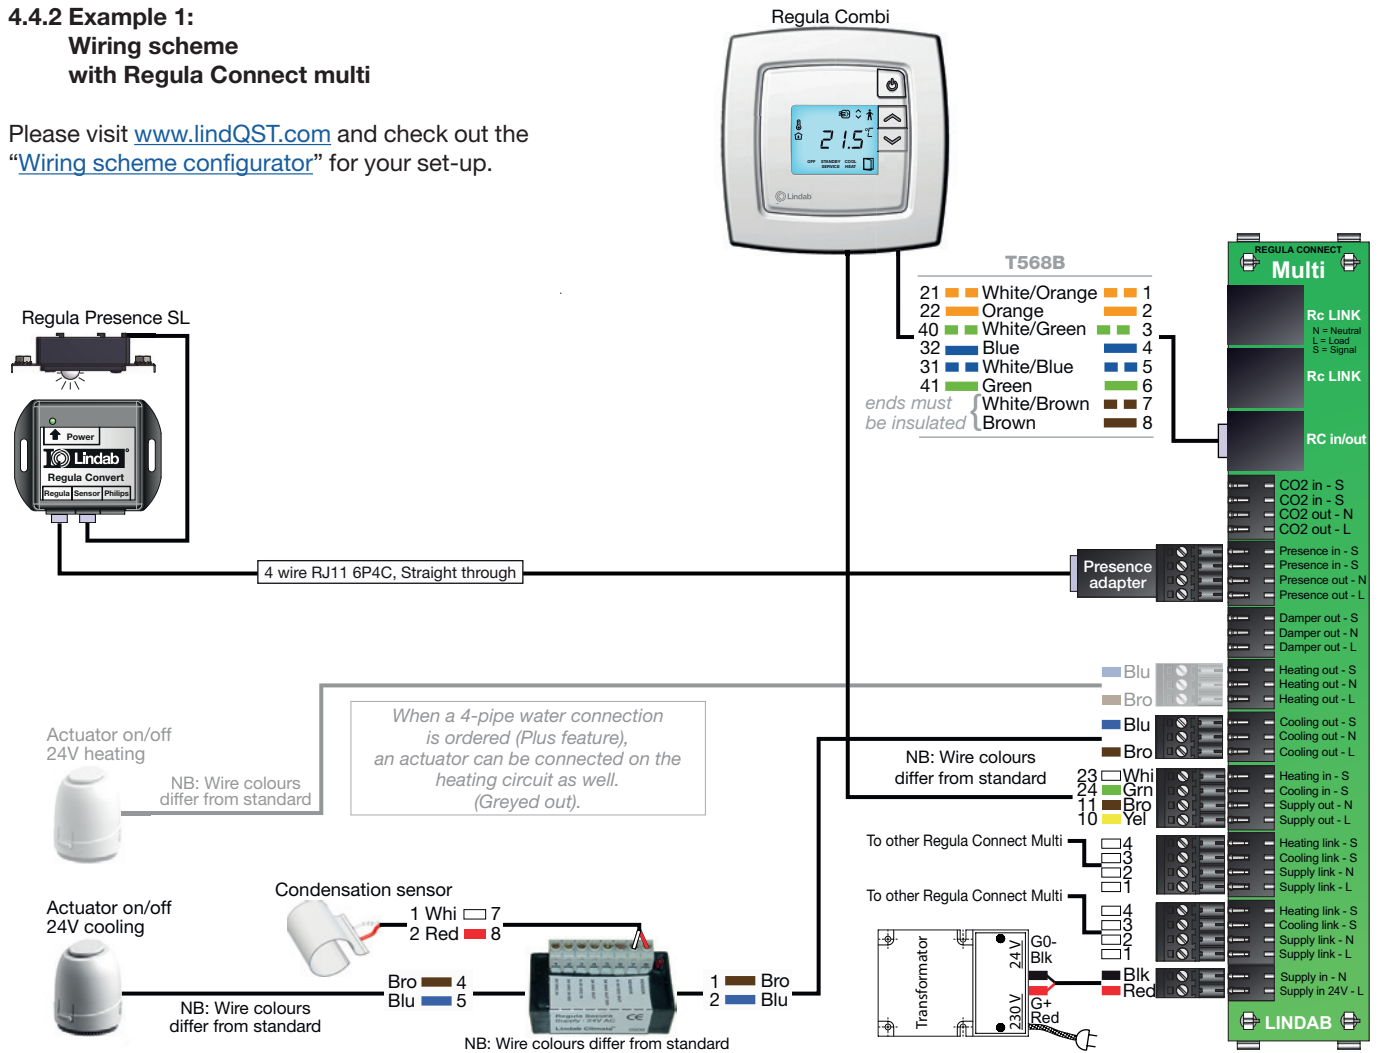

4.4.3 Example 2: Wiring scheme with Regula Connect basic

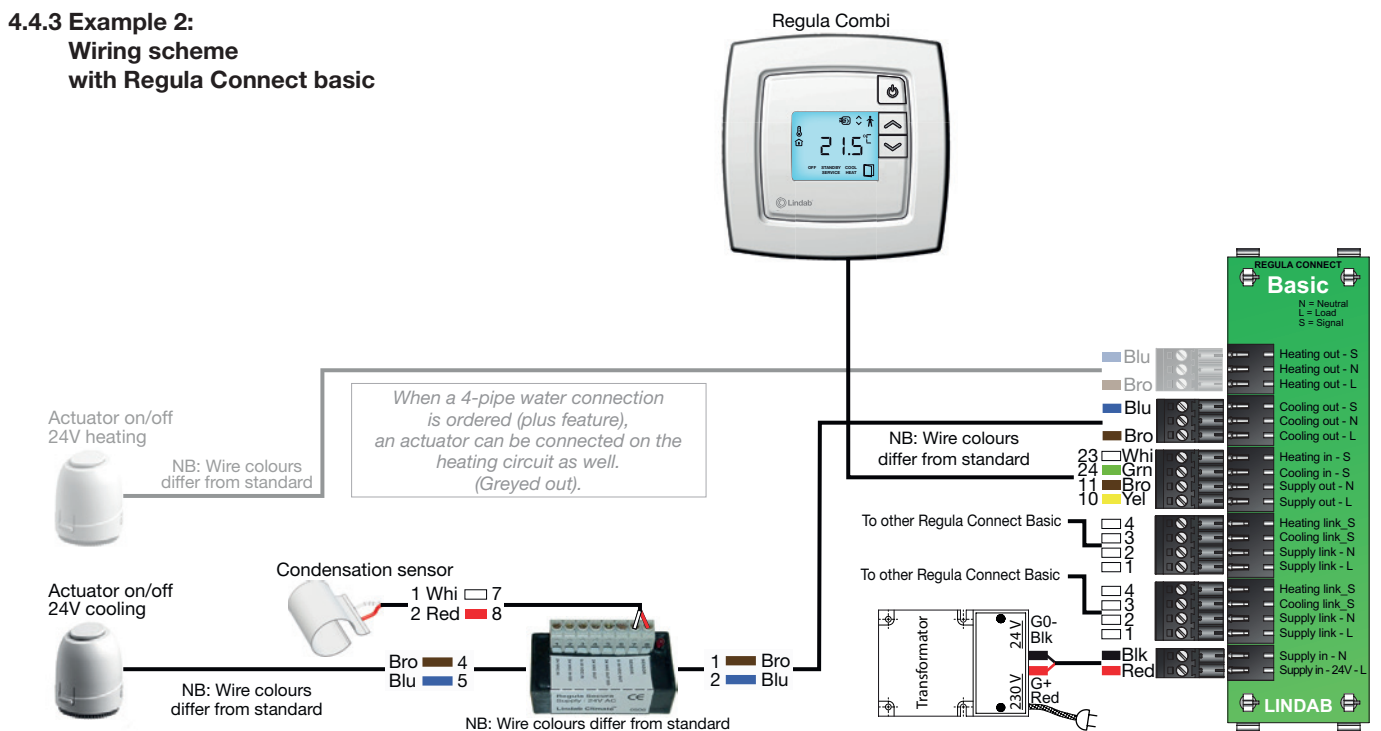

Installation instruction

Plexus

4.4.4 Regula Connect on the beam

Connect cards are pre-installed when the beam is ordered with PLUS-features.

See [Regula Connect](#) for more details.

Regula Connect Basic



Regula Connect Pascal




Regula Connect Multi



4.4.5 Regula Secura on the beam

Regula Secura is pre-installed when the beam is ordered with PLUS-features. See [Regula Secura](#) for more details.

Condensation sensor and Regula Secura

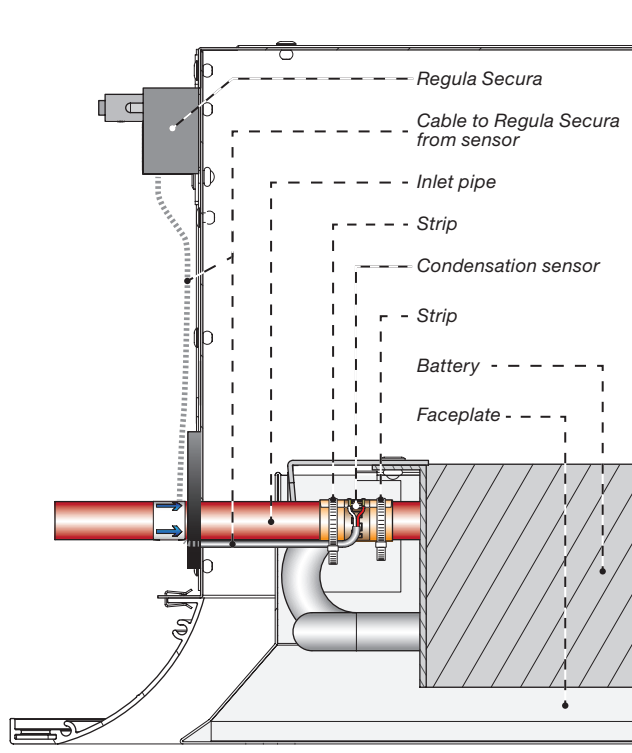

4.4.6 Valves and Actuators on the beam

Description, see 2.16.3 and 2.16.4.

4.4.7 Regula Combi on/with the beam

The Regula Combi can be controlled and programmed locally in the display, or at a remote location by a EXOLINE or MODBUS communication system. Handles both 24V and 0-10V devices.



See the [Regula Combi](#) documentation.

4.4.8 Actuators

Description, see 2.16.4.

Installation instruction

Plexus















5. Installation of product

5.1 Handling of product

For the handling of the product please refer to 2.5.

5.2 Adaption to ceiling systems

5.2.1 Ceiling systems

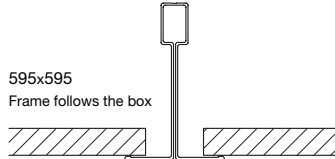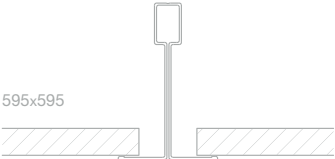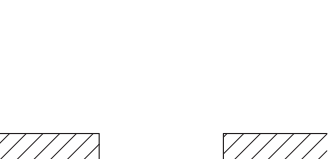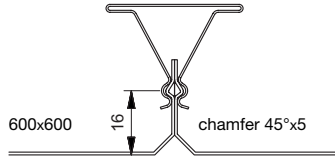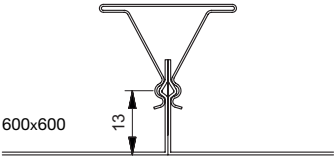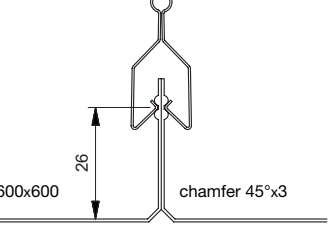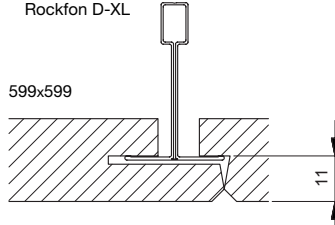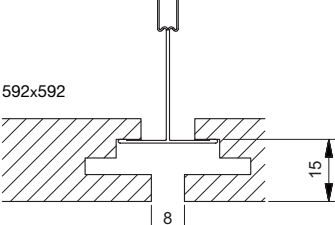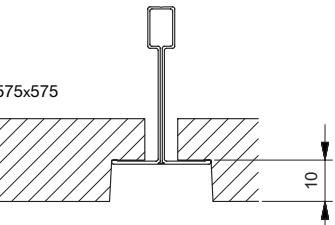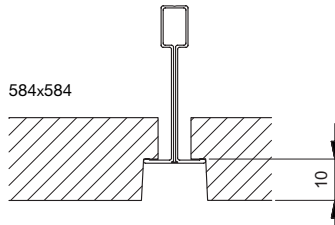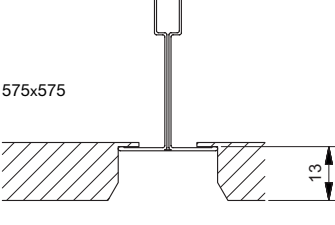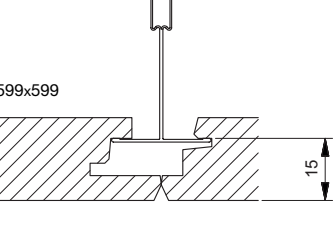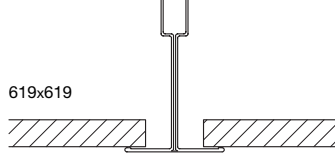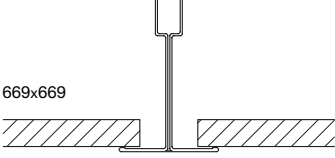01 T24/T15 Lay-in 600 Danotile T24/T25 Ecophon T24 Rockfon A24  595x595 Frame follows the box	02 T24/T15 Lay-in 600 not cleanable  595x595	03 Permanent ceiling 
04 Dampa Clip-in bevelled edge  600x600 16 chamfer 45°x5	05 Dampa Clip-in square edge  600x600 13	06 Luxalon SQ Clip-in  600x600 26 chamfer 45°x3
07 Danotile Contur Ecophon D Rockfon D-XL  599x599 11	08 Ecophon Focus DG  592x592 15 8	09 Rockfon E10 24 Ecophon -E /T24  575x575 10
10 Rockfon E10 15 Ecophon -E / T15  584x584 10	11 Danotile Markant  575x575 13	14 Ecophon Focus DS Rockfon Sonar X  599x599 15
21 T24/T15 Lay-in 625  619x619	31 T24/T15 Lay-in 675  669x669	22 T24/T15 Lay-in 625 not cleanable  619x619







Installation instruction

Plexus

5.2.2 Adaption to ceiling system

Ceilingtype 01, 08, 09, 10, 11, 21, 31, Plexus I (Y, Z)

Plexus I	(S/SA, L, M, H) 60	(S/SA, H) 120	01, 08
Plexus I	(S, L, M, H) 62	(S, H) 120	21
Plexus I	(S, L, M, H) 67		31
Plexus I (Y)	(S, L, M, H) 60	(S, H) 120	09, 11
Plexus I (Z)	(S, L, M, H) 60	(S, H) 120	10

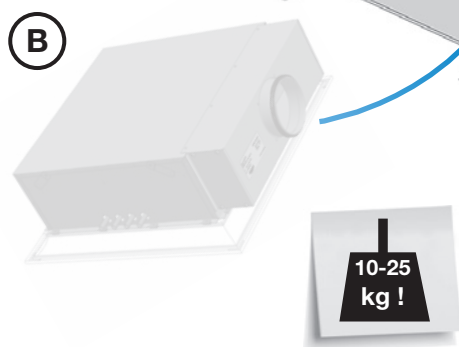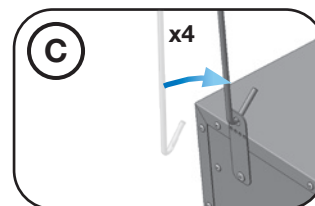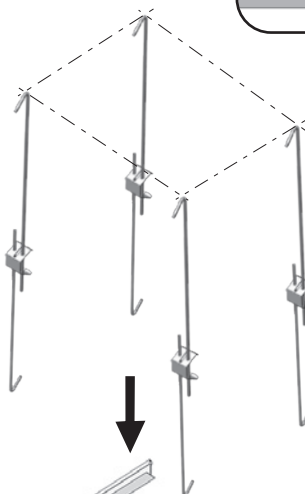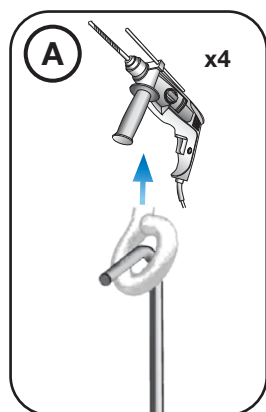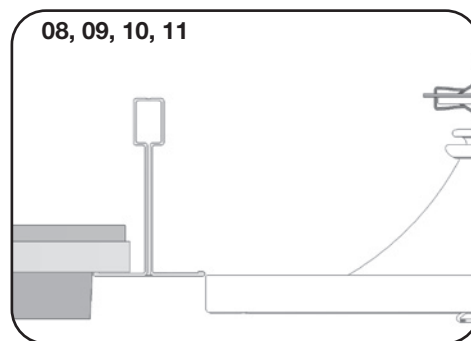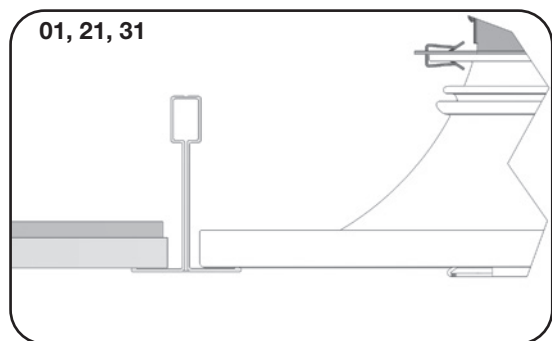






Installation instruction

Plexus

Ceilingtype 03, Permanent ceiling, Plexus I

Cutout dimensions in permanent ceiling:






Plexus I (S/SA, L, M, H) 60	= 544 x 544 mm
Plexus I (S/SA, H) 120	= 544 x 1144 mm
Plexus I-62 (S, L, M, H)	= 569 x 569 mm
Plexus I-67 (S, L, M, H)	= 619 x 619 mm

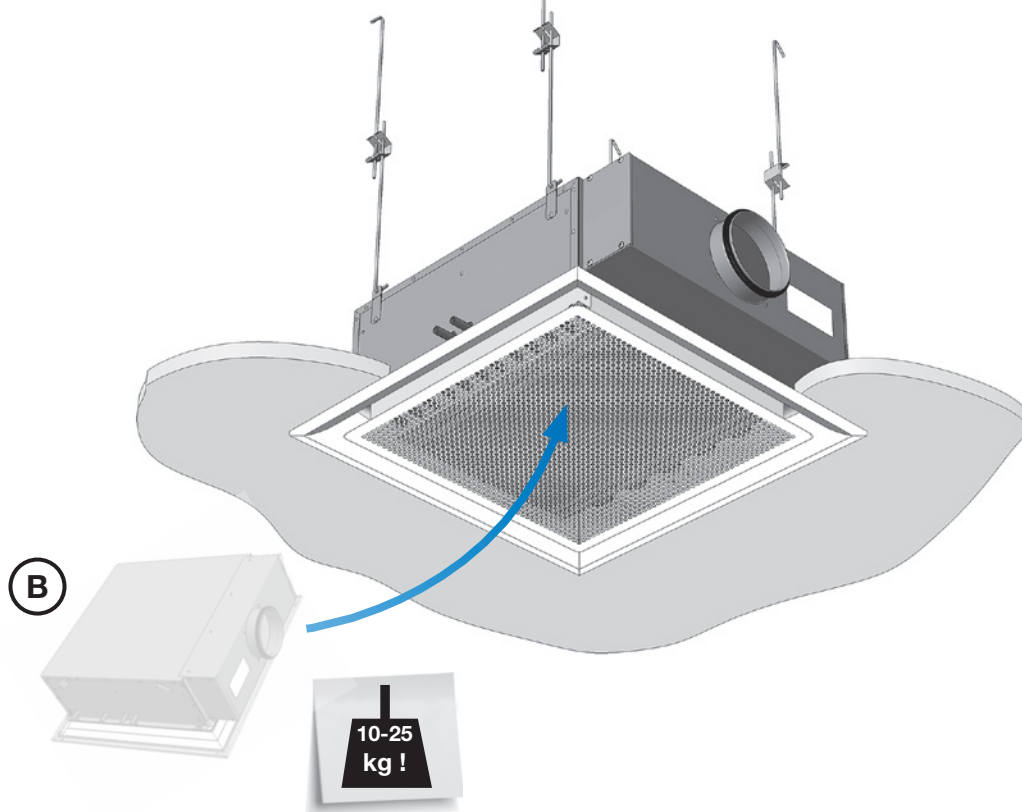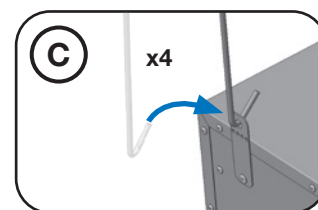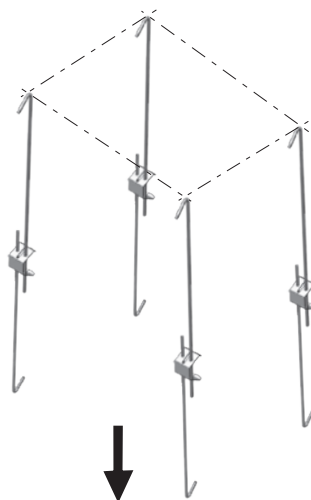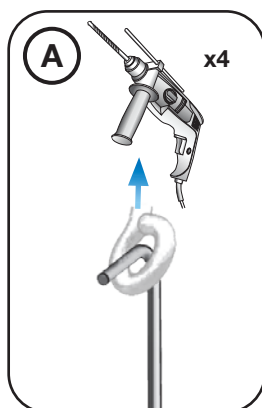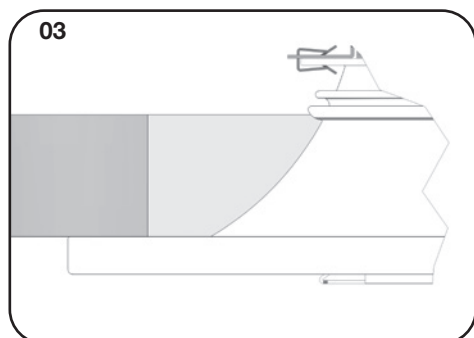


Installation instruction

Plexus

Ceilingtype 04, 05, 06, 07, 14, Plexus I (X)

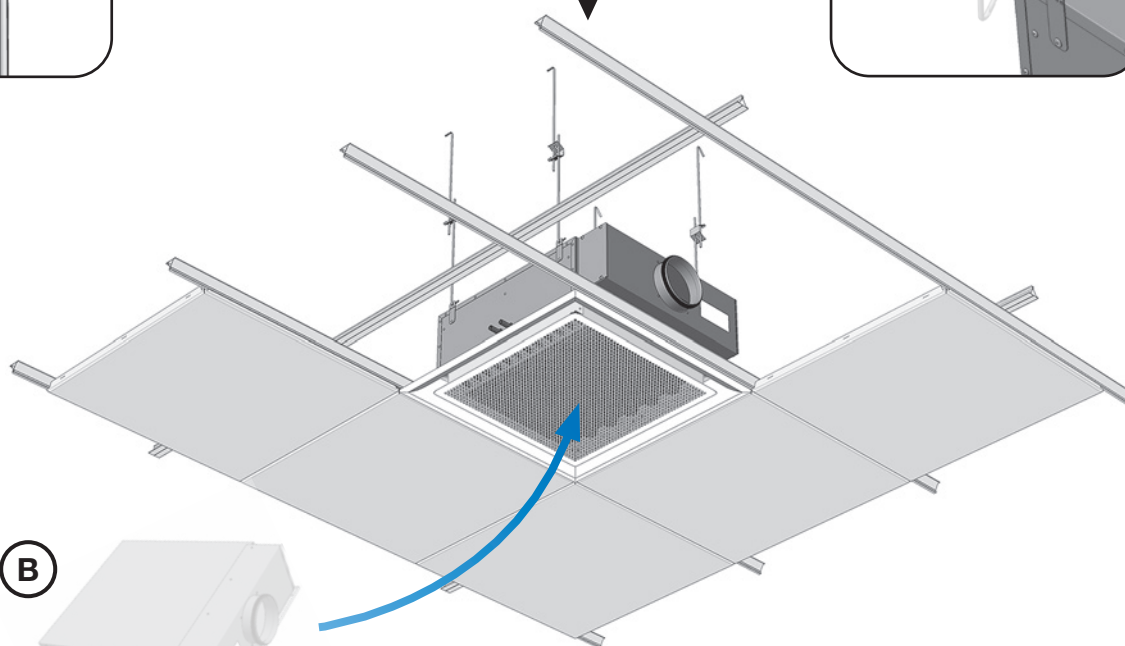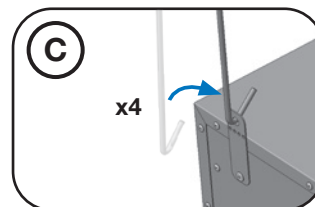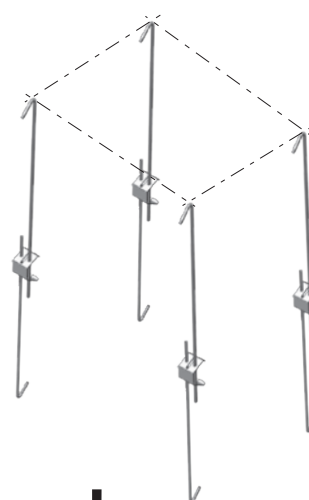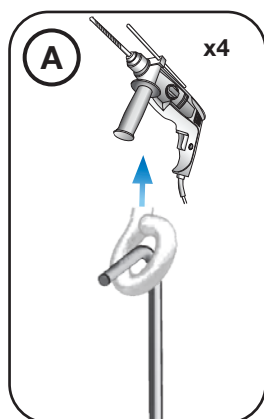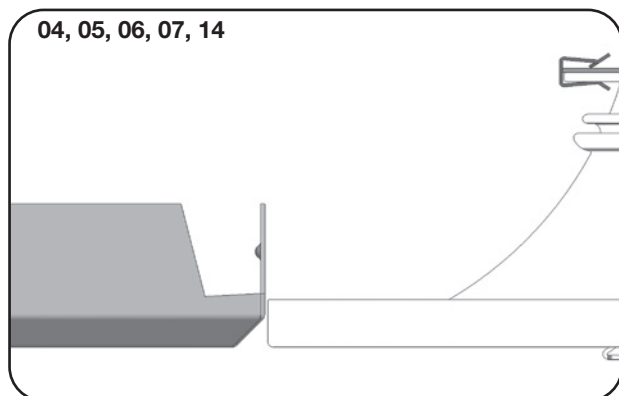


B



Installation instruction

Plexus

Freehanging, exposed, Plexus F

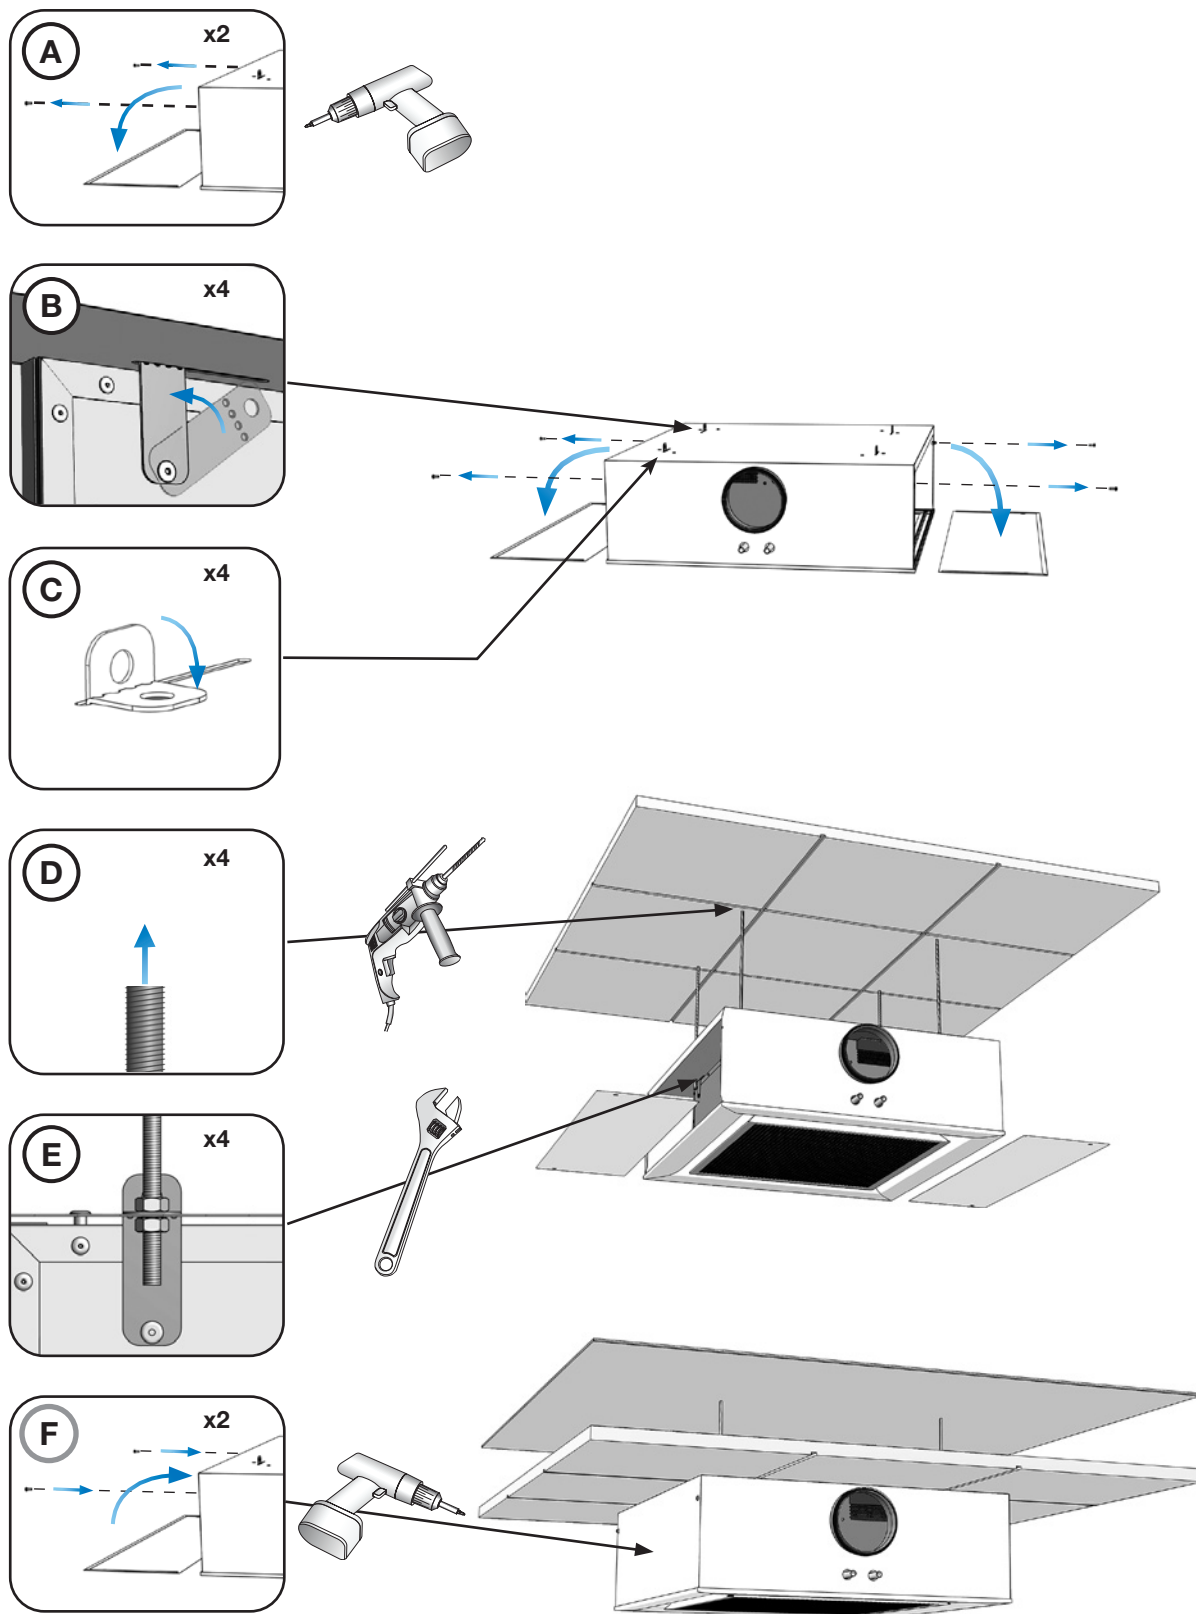


Installation instruction


Plexus

5.3 General installation principles


5.3.1 Recessed in suspended T-bar ceiling

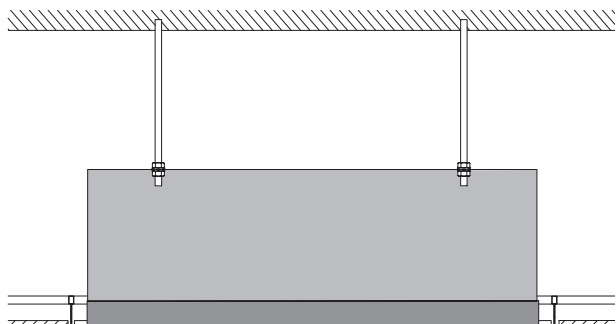


5.3.2 Exposed, sealed to the ceiling

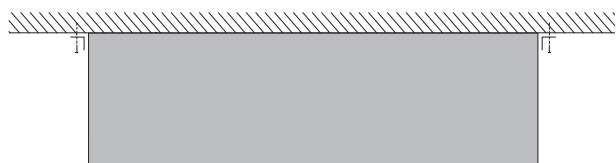


5.3.3 Exposed, free hanging

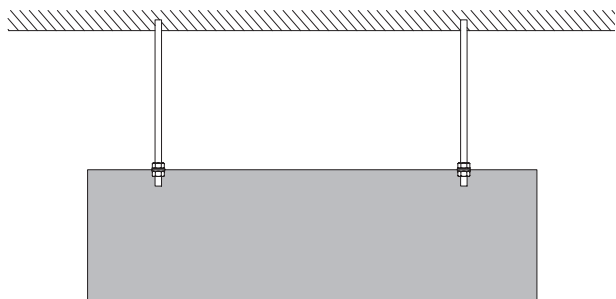


5.3.4 Free hanging above perforated or egg-crate ceiling

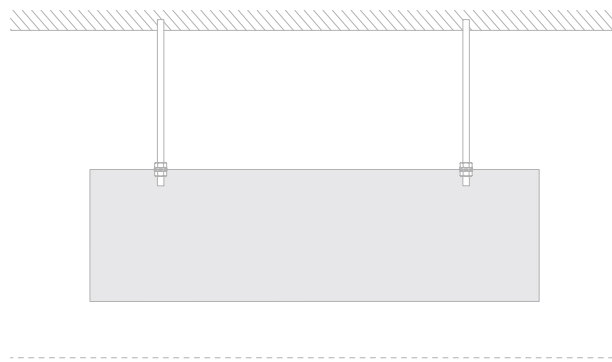

5.3.5 Recessed in suspended (permanent) ceiling

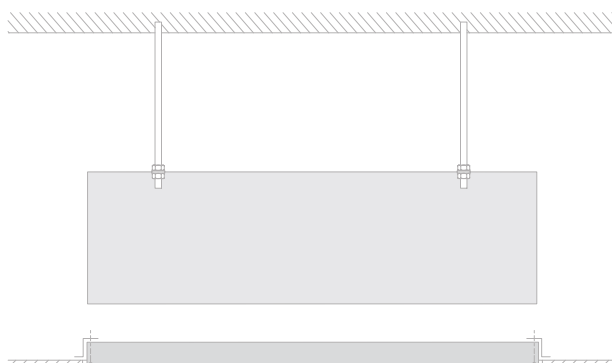

5.3.6 Recessed in suspended (permanent) ceiling without cover flanges

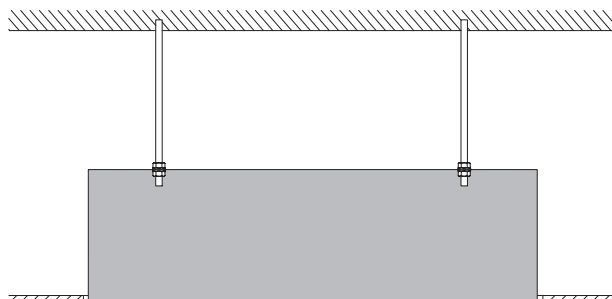


Installation instruction

Plexus

5.4 Preparation for installation on the product


The beam is prepared for installation by hangers (4 x per beam). 4 turnable/bendable brackets on the Plexus' models ensures the possibility to use different hanger systems.

1. Threaded rods M8	Plexus 60 : 371 x 497 mm	Plexus 120 : 371 x 1097 mm
2. Pendulum hangers (in different sizes)	: 371 x 477 mm	: 371 x 1077 mm
3. Wiring hanger system	: 371 x 477 mm	: 371 x 1077 mm

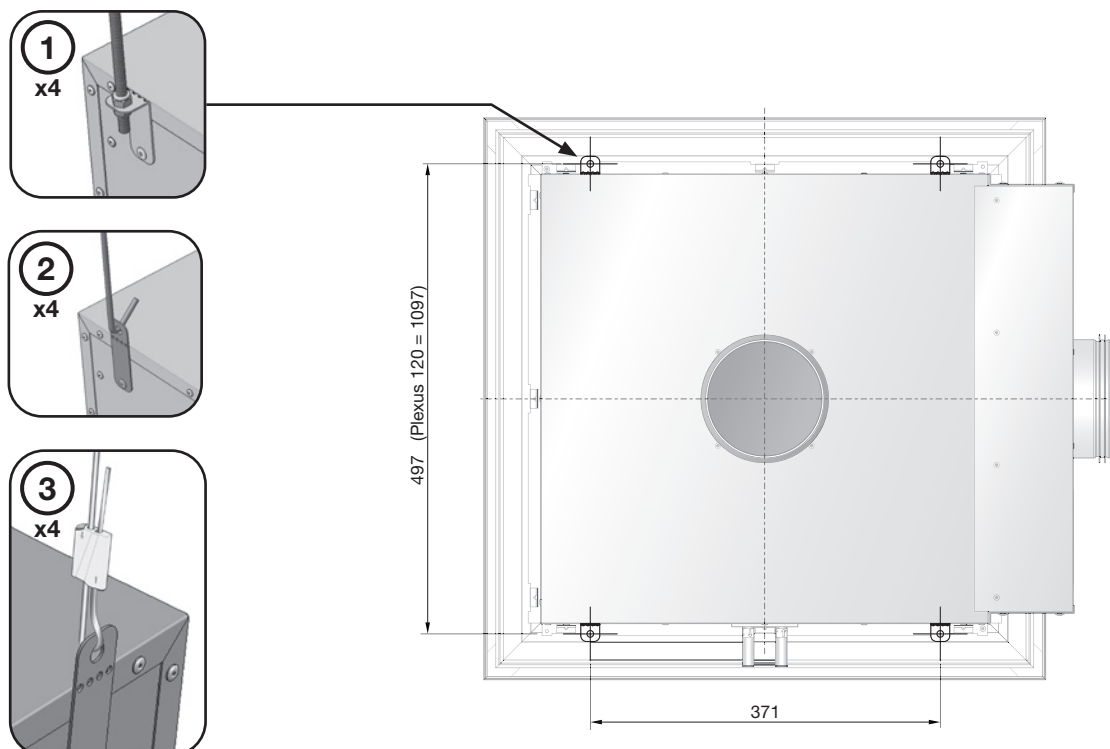

5.5 Basic steps of installing the product






1. Threaded rods M8

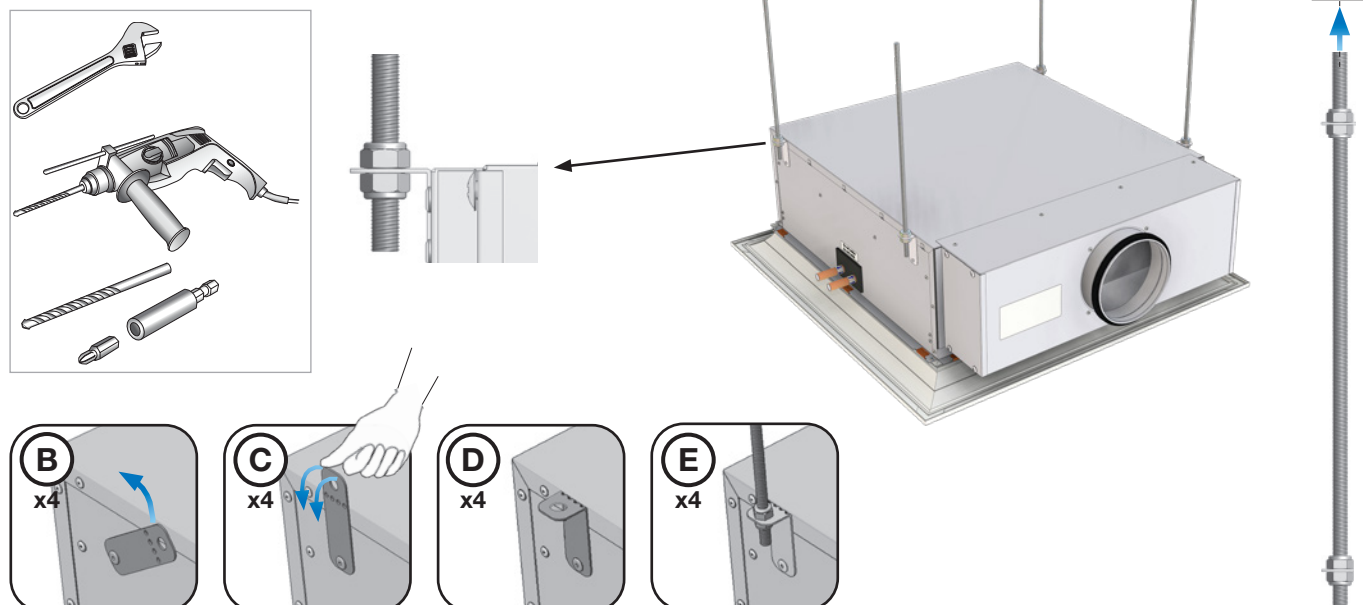


Installation instruction

Plexus





2. Pendulum hangers (in different sizes)

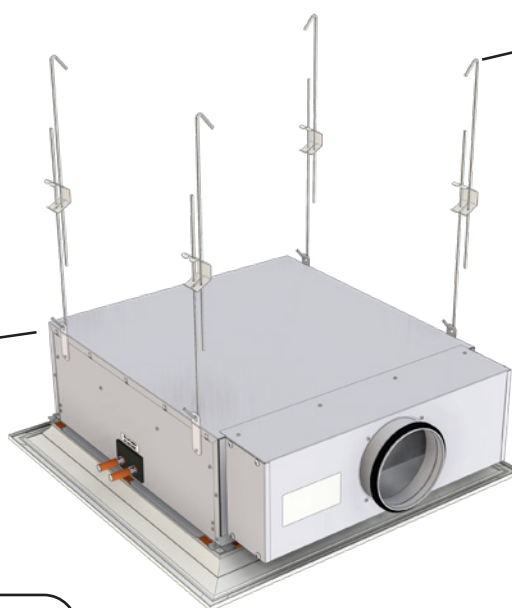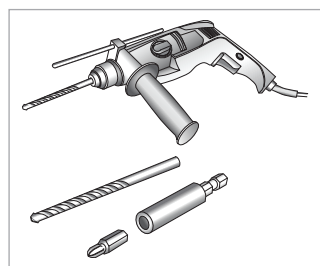

3. Wiring hanger system

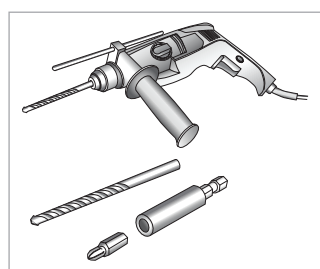


Please check local Lindab branches for local assortment.

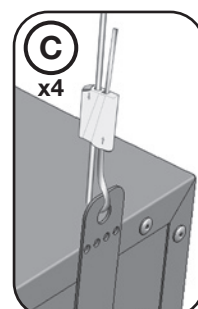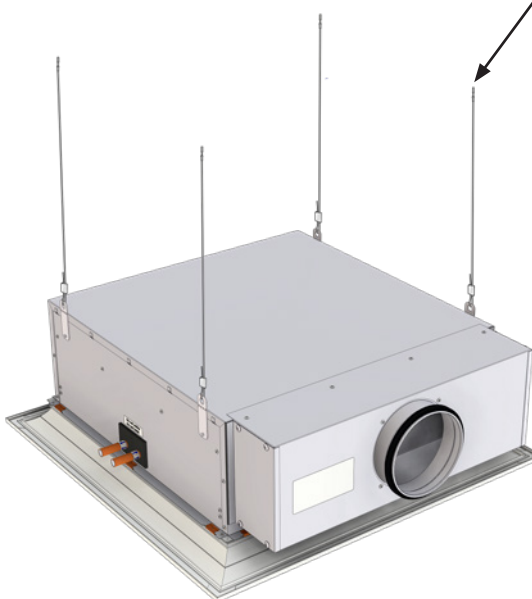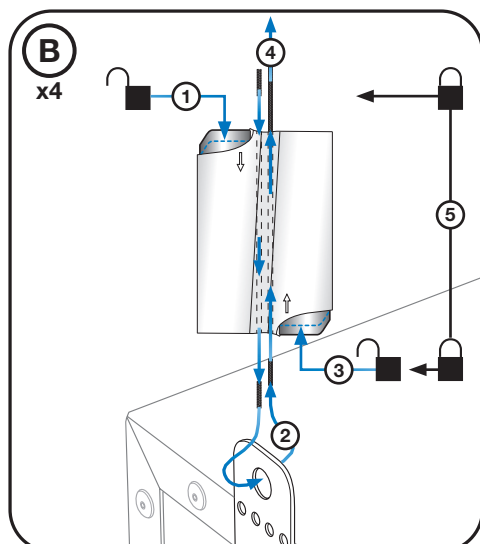

6.1 Airflow and pressure

6.1.1 Jetcone adjustment pins

Plexus I-60 seen from below with faceplate of, showing the adjustment pin versions in plastic and aluminium.



Installation instruction

Plexus




6.1.2 Finding values for JetCone pins

Example:


Plexus-I-L-60-12-125-A5-2400-70-16

$\Delta p_{\text{stat}} = 70 \text{ Pa}$ (Static pressure).

$q_a = 16 \text{ (l/s)}$ (Primary airflow rate).

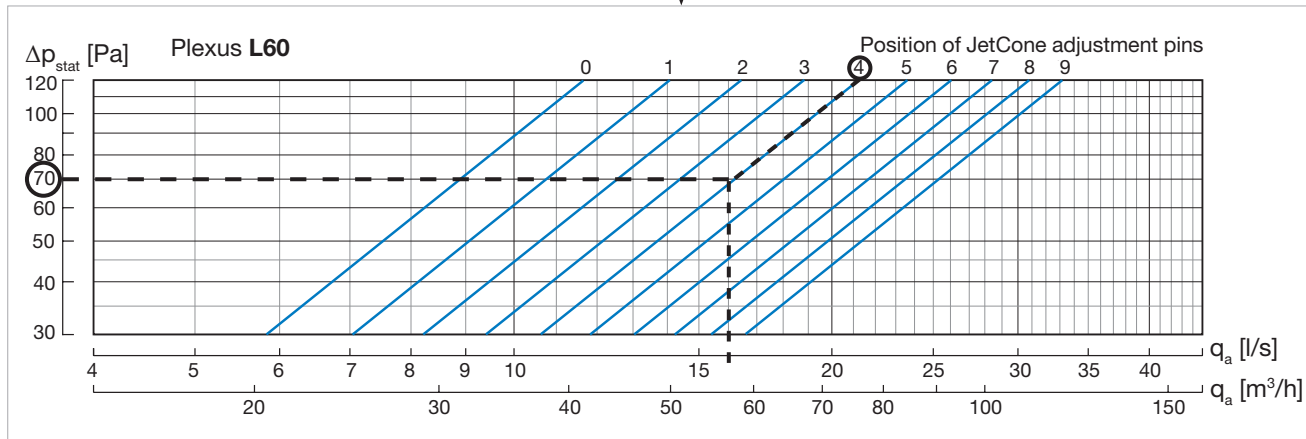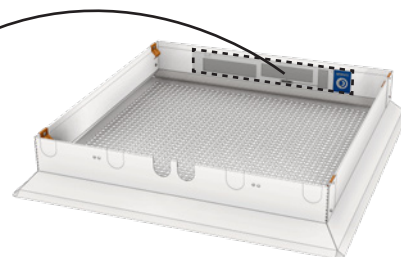

6.1.3 Adjusting air flow and pressure with JetCone pins

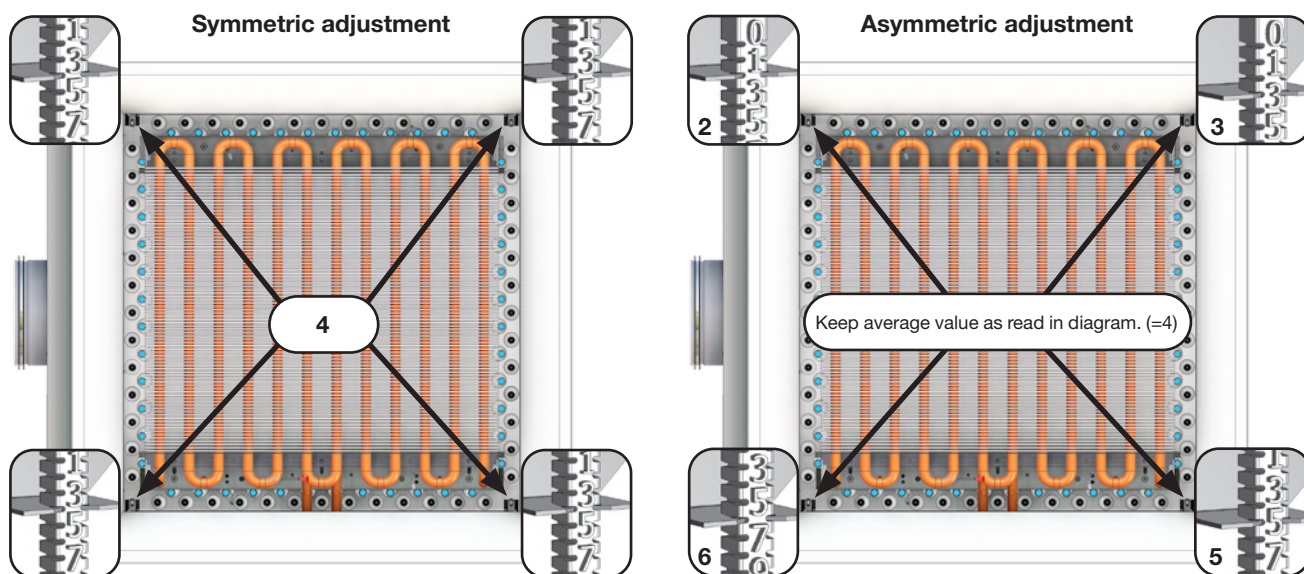

Installation instruction

Plexus

6.2 Adjustment of air distribution profile


Plexus comes as standard (S) with fixed angled JetCone Nozzles, which provide 360° optimal air distribution.

6.3 Measuring air pressure and calculating the air flow

Before calculating the airflow, the static nozzle pressure must first be measured. The static nozzle pressure is the air pressure available at the nozzles.

6.3.1 Measuring static nozzle pressure and air pressure

- To measure the air pressure, a manometer, (analogue or digital) will be needed. Lindab recommends PC410.
- Insert the measuring tube onto the specialized measuring nozzle.
- Read of the static nozzle pressure from the manometer (PC410).

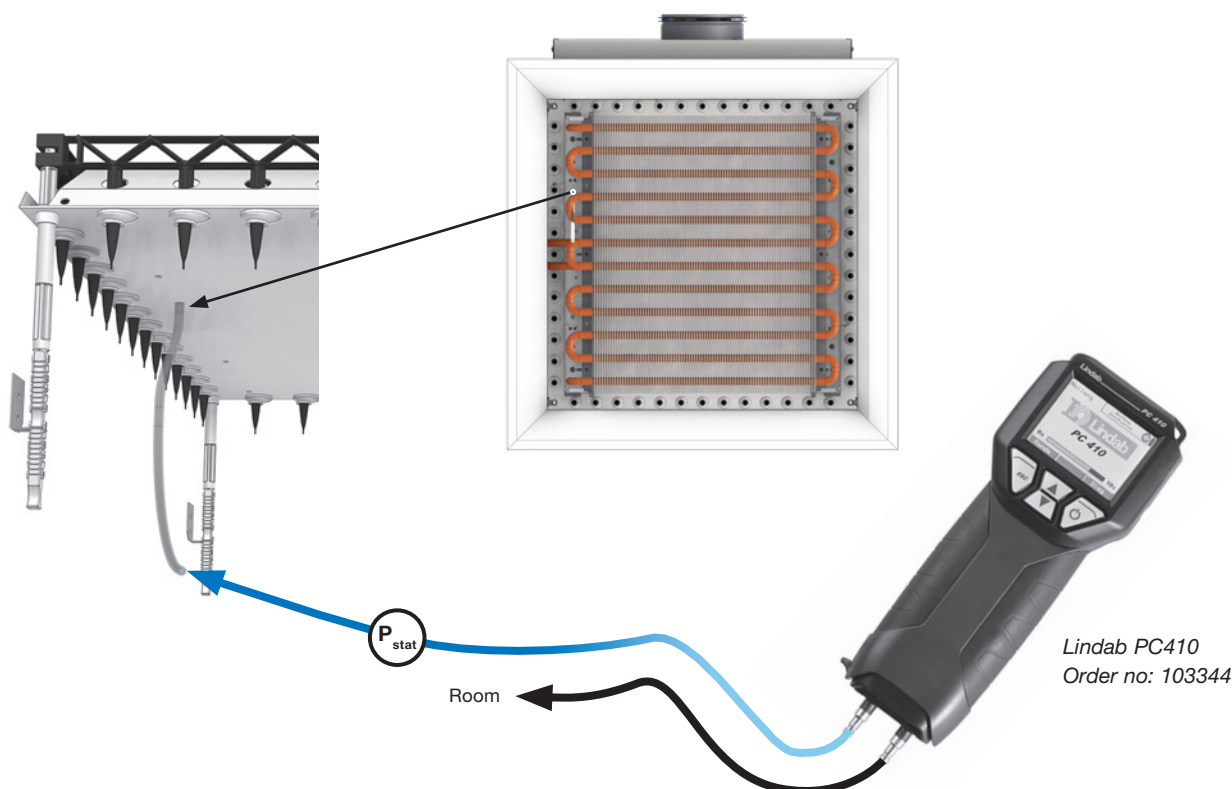

6.3.2 Calculating the actual air flow

- After measuring the static pressure, read the settings of the four JetCone adjustment pins to find the mean value of the pins.
- Locate the diagram inside the openable perforated faceplate, (also see next page), and use the static nozzle pressure and the mean value of the pins to find the current airflow.

6.3.3 Changing the actual air flow

- Measure the static nozzle pressure.
- Locate the air pressure/airflow diagram inside the openable perforated faceplate. (Also see diagrams on next page).
- Find the mean value of the 4 pins to reach the desired airflow, in the diagram. Use the static nozzle pressure and the desired airflow to find the mean value of the 4 pins.
- Adjust the 4 pins in the Plexus, so the mean value of the pins will correspond with the mean value found in the diagram.
- See example in 6.1.3, asymmetric pin setting: $2 + 3 + 5 + 6 = 16/4 = 4$. (Where (4) was the value read in diagram).





6.3.4 Changing the air distribution profile

See 6.1.3.

Installation instruction



Plexus

6.3.5 Plexus pressure / airflow diagrams

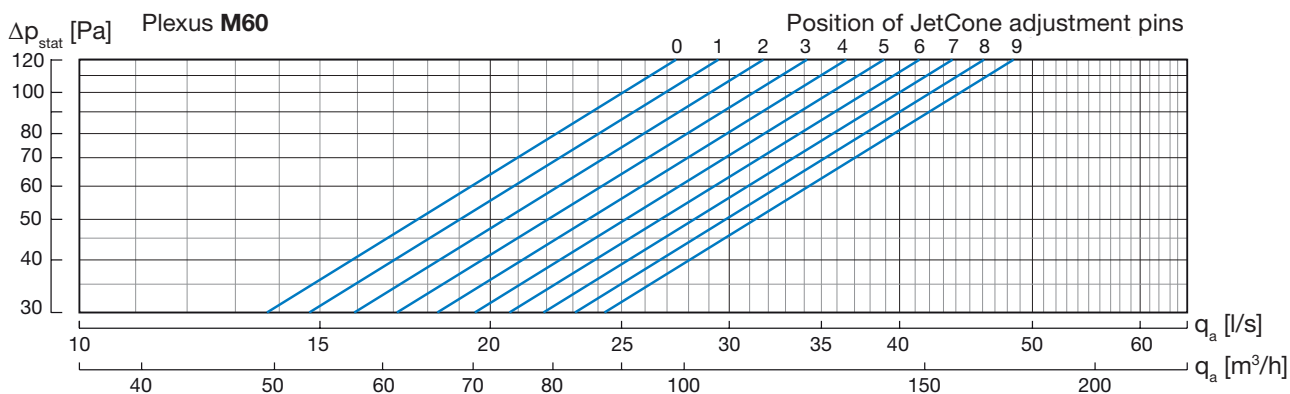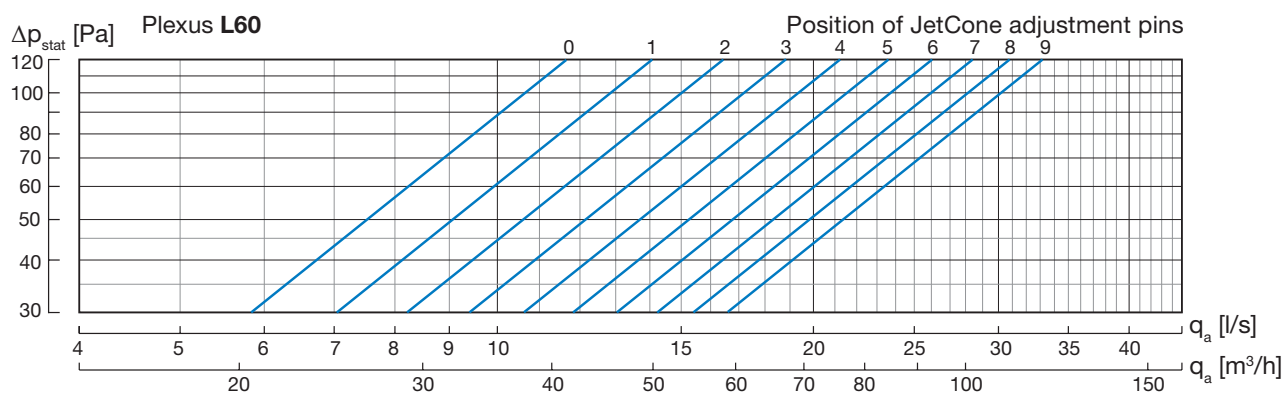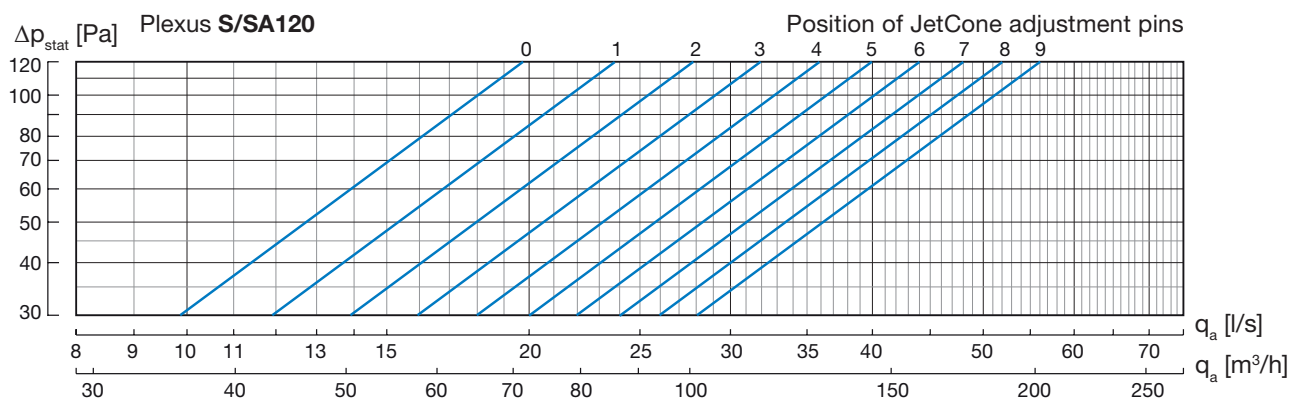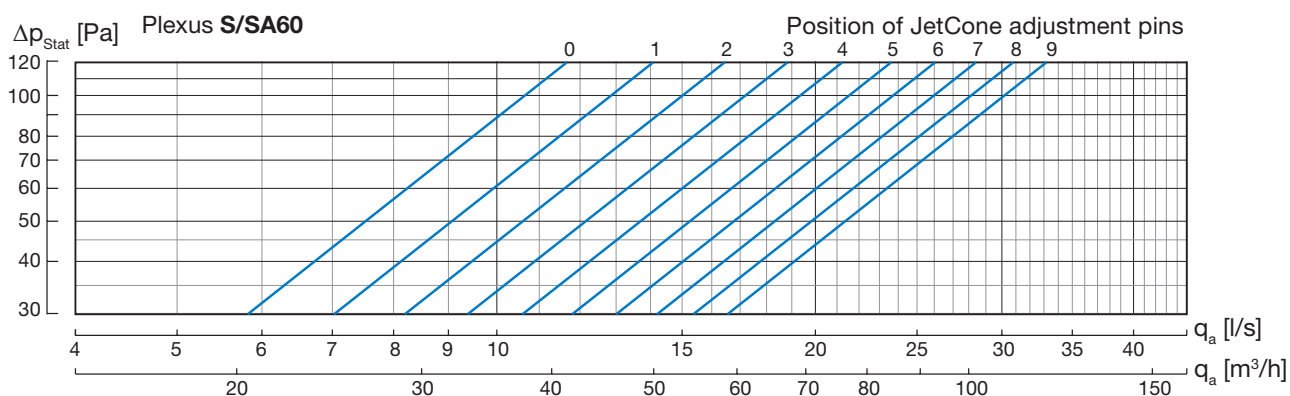

Installation instruction

Plexus

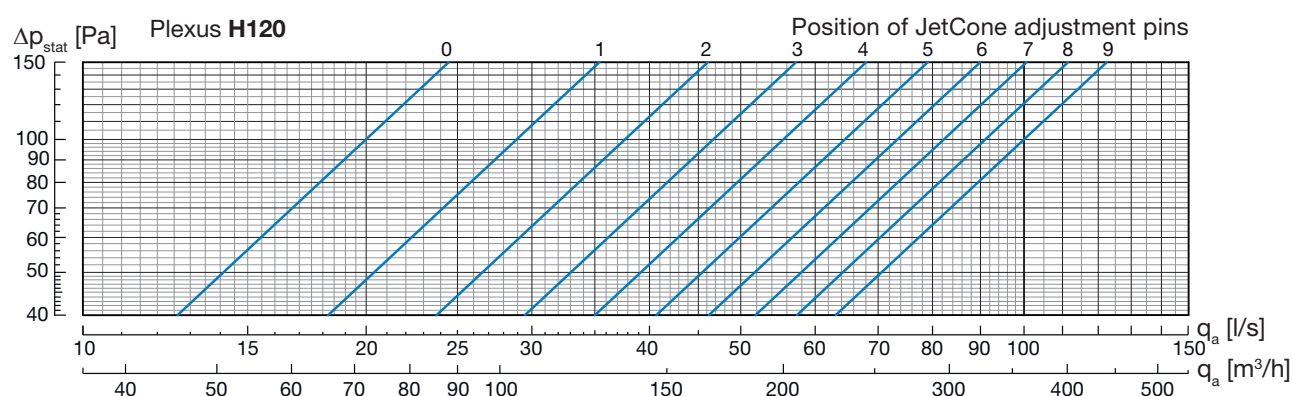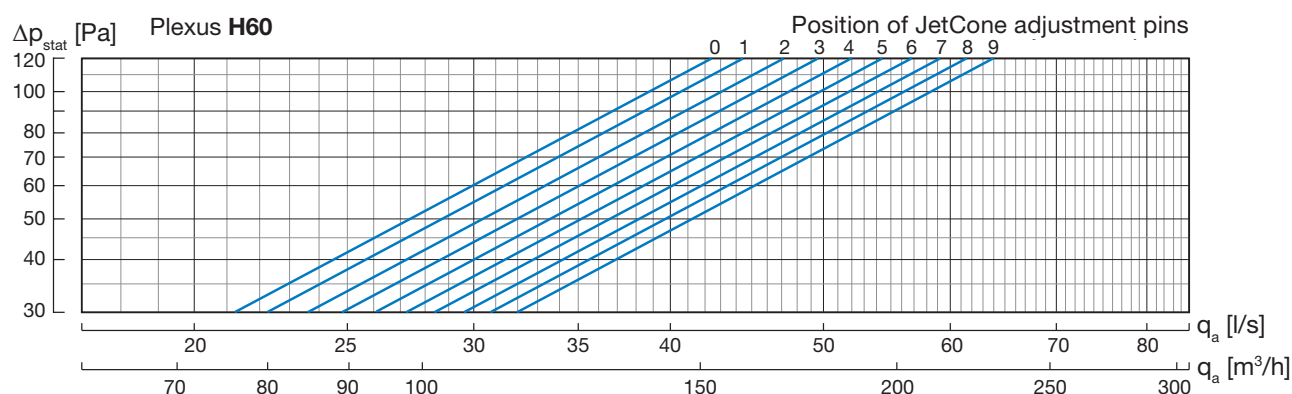

6.4 Water flow rate

6.4.1 Pre-setting of valves

All the integrated control valves (plus feature) are delivered not set. The presetting has to be done on site. For the presetting of valves, please see [LinFlow-A](#) (Angled) and [LinFlow-S](#) (Straight) water valves documentation.

6.4.2 Balancing strategy

Lindab recommends always balancing the water system to guarantee thermal comfort in all areas, to avoid noise nuisance problems and to save energy. A hydraulic balance is obvious to ensure that all the beams (panels or facade units) in the system will always be supplied with their required (planned) water flow rates (calculated with [LindQST\waterborne calculator](#)).

Lindab refers to the proportional method, where all beams (panels or facade units) are balanced to the same proportion of the requested water flow rate.

Installation instruction

Plexus

7. Maintenance

The interval of cleaning depends on the indoor environment where the beam is placed. Under optimal conditions the beams only need cleaning every 5 years.


- Open the inlet plate using no tools (7.2)
- Clean the battery downside and the inlet faceplate inner parts with a dust cleaner / vacuum cleaner.
- Only use lukewarm water and a mild detergent and a piece of wet cloth to clean the inlet face plate.
- Open the inspection hatch (7.3)
- Clean the air plenum chamber and air connection with a vacuum cleaner
- Lower battery if water pipe connections are connected to system by flexhoses. (Otherwise this is not possible, See 7.4).
- Clean the top side of the battery, nozzle plate, JetCones and the mixing chamber with a dust cleaner / vacuum cleaner.

7.1 Remove the outlet front grille

Not relevant for Plexus.

7.2 Open inlet faceplate

7.3 Opening inspection hatch



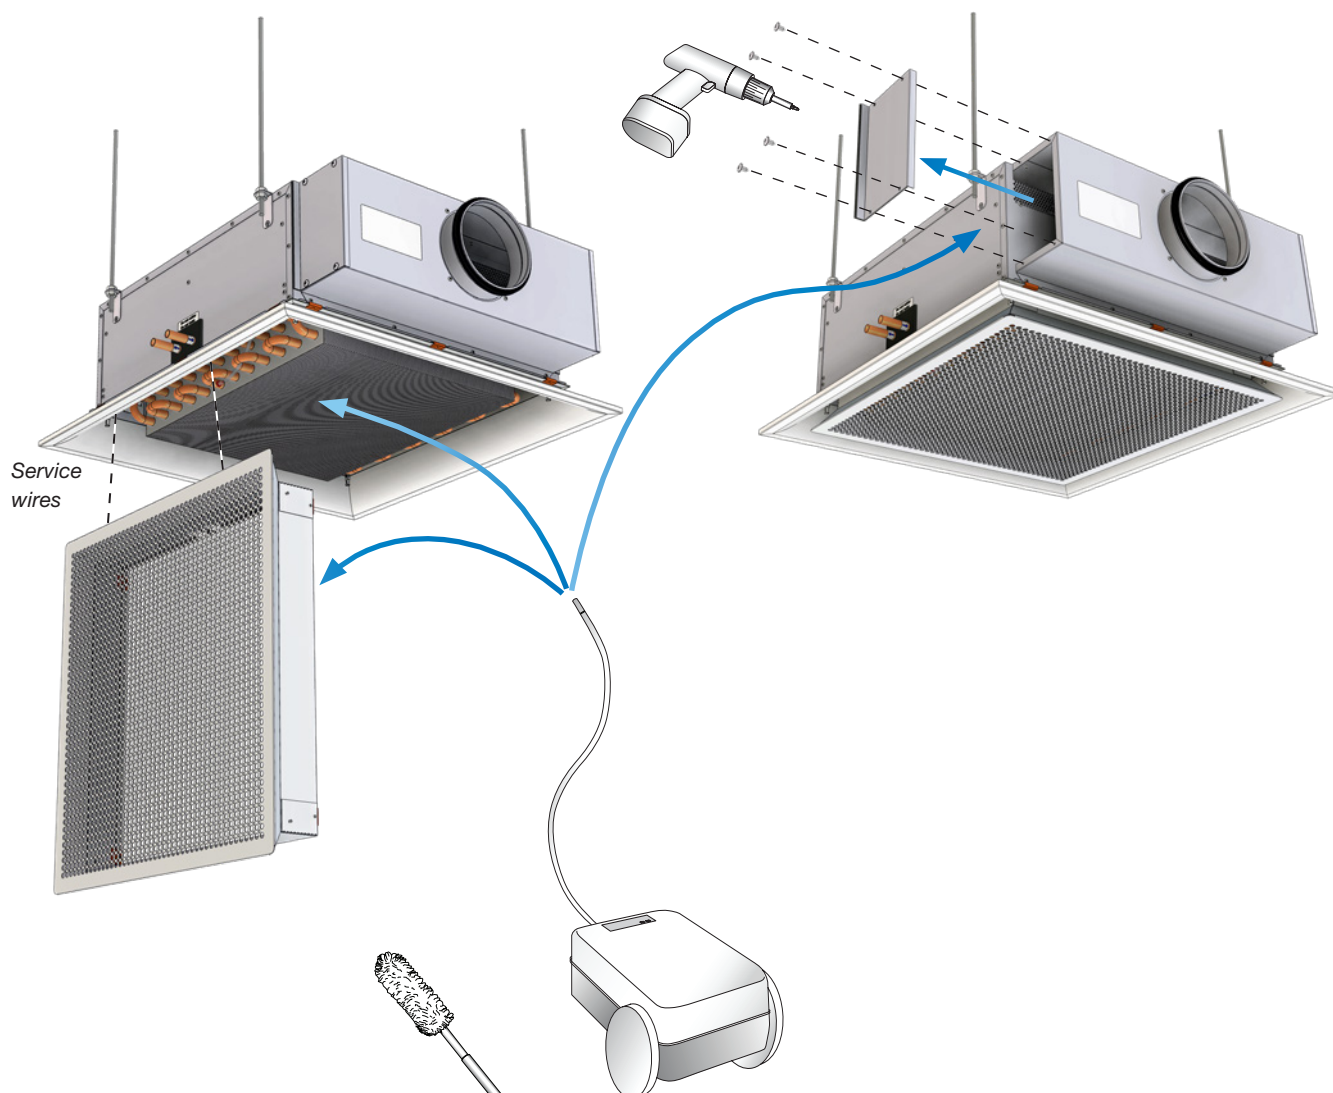


Installation instruction

Plexus

7.4 Lower battery

Battery can only be lowered when the plus feature "dropdown battery" is ordered. This plus feature is only available for Plexus-I models and not in combination with any other plus features integrated in the front plate (e.g. Regula Combi or/and presence sensors!)

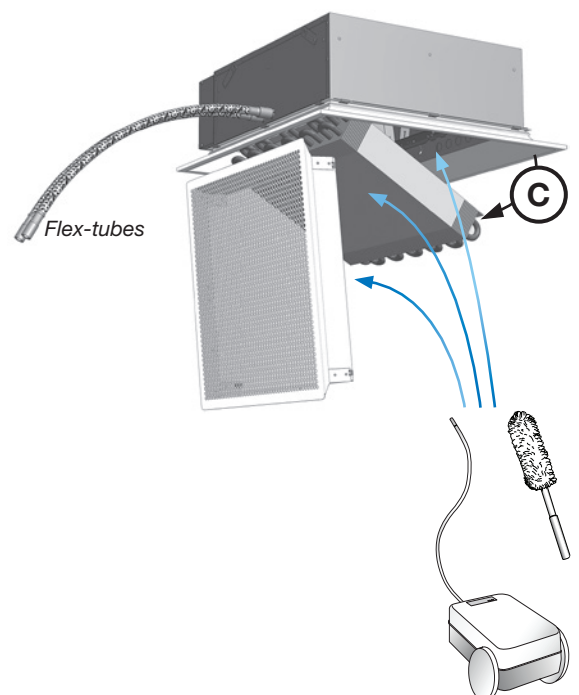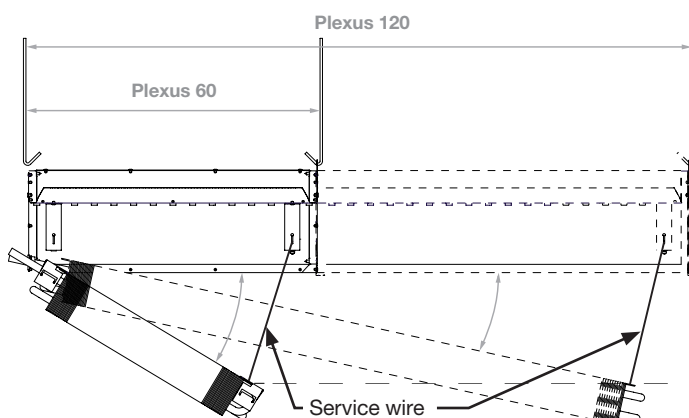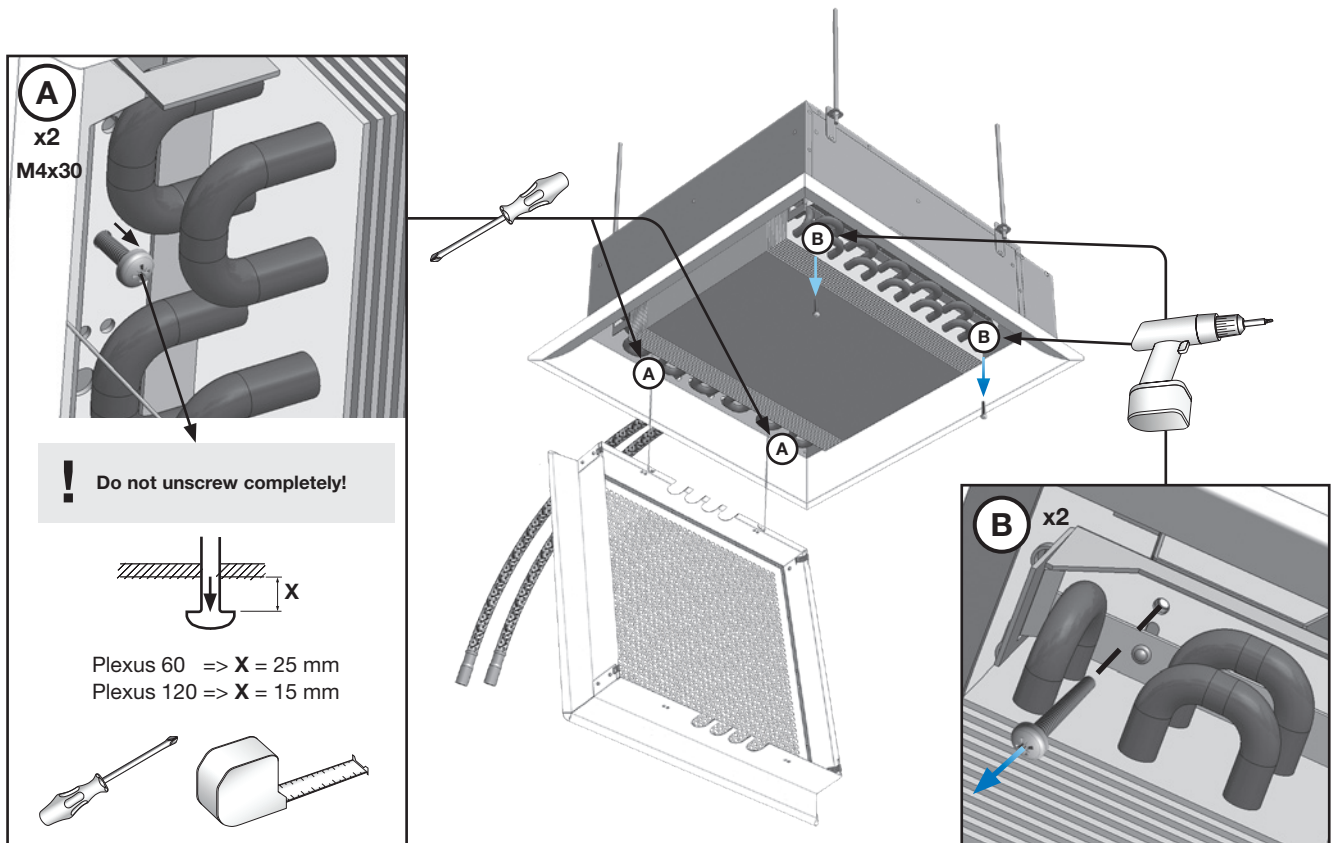

Installation instruction

Plexus

7.5 Turnable battery



The water battery can be turned easily on site to change e.g. water connection (A5) to (A6) or vice versa (only available for 2-pipe connections and models without plus features).

Re-use pipe-covers (C) and plastic plugs (H).

Lindab recommends to change battery before installation in ceiling.

1. Take battery out of A5

- A** - Un-Click and open faceplate.
- B** - Release service wires (x2) and remove faceplate.
- C** - Gently remove pipe covers for re-use (x2).
- D** - Unscrew battery (x4) and carefully tilt it slightly upwards.
- E** - Free measuring tube (x1) from pipe-loops and gently release it from battery-bracket hole.
- F** - Take battery out.
- G** - Release faceplate service wires from brackets inside beam. To be reused (x2).
- H** - Take out plugs from A6 holes. To be reused (x2).

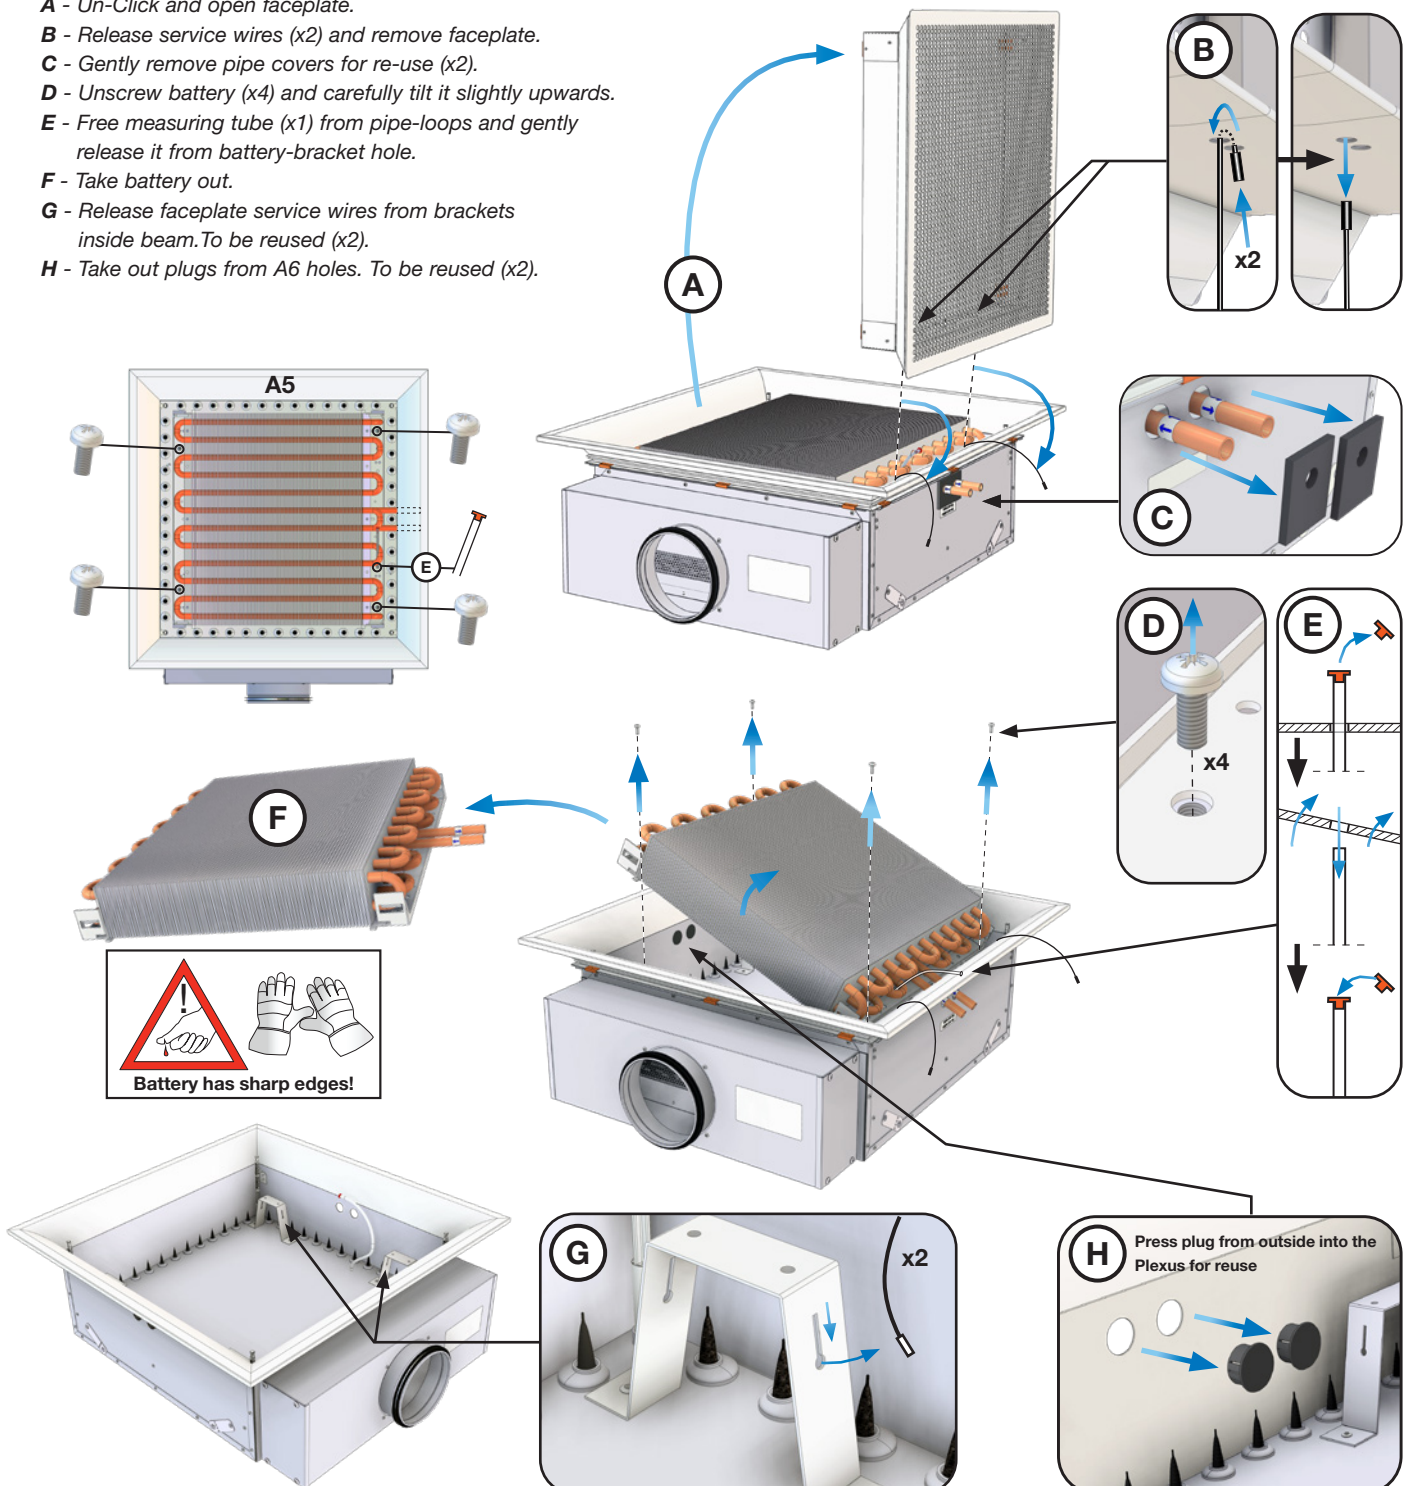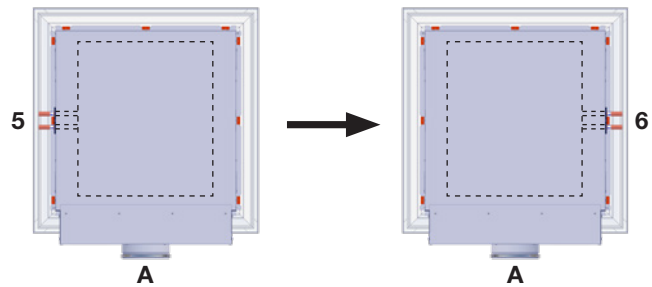

Installation instruction

Plexus

2. Reinstall battery as an A6 model

A - Reattach faceplate service wires (x2) to brackets in A6 side inside beam.

B - Reinsert plugs (x2) in A5 pipe-holes.

C - Rotate battery 180 degrees and gently reinsert with inlet/outlet pipes first into A6 pipe holes.










D - While inserting and lowering battery, the measuring tube (x1) must be reinserted through correct hole in battery bracket.

E - Now lower battery into position and lock it with the 4 screws (x4).

F - Gently re-insert pipe covers on the inlet/outlet pipes

G - Arrange measuring tube around pipe loops so it will not dangle and touch faceplate when installed.

H - Mirror faceplate (from A5 position) so it will fit A6 configuration and reattach faceplate service wires to faceplate. The faceplate can now be closed and clicked on.

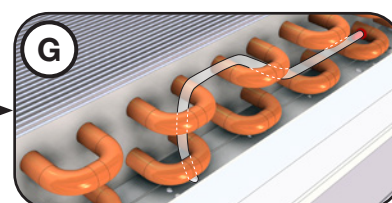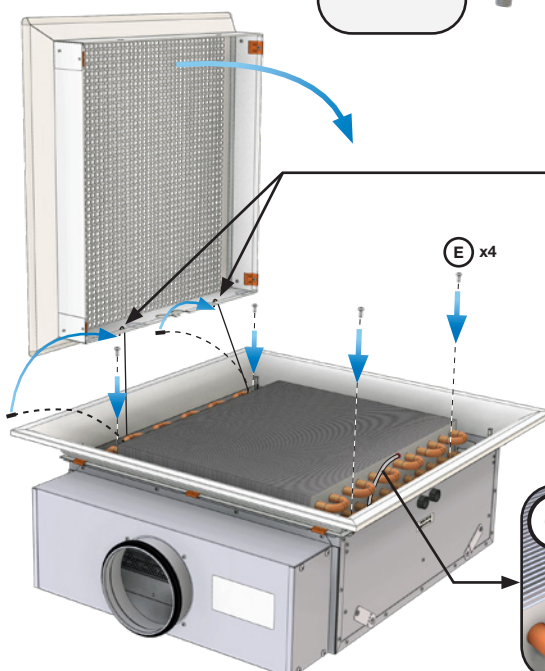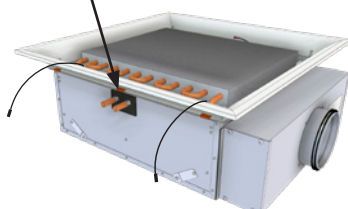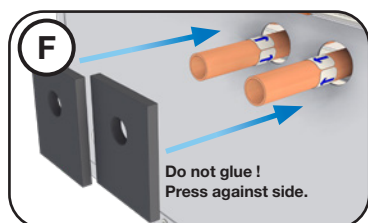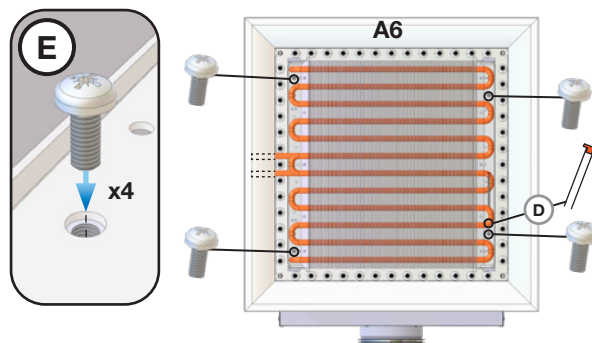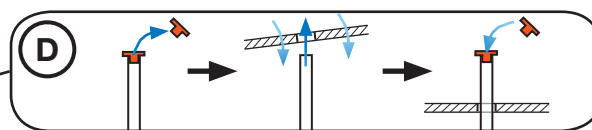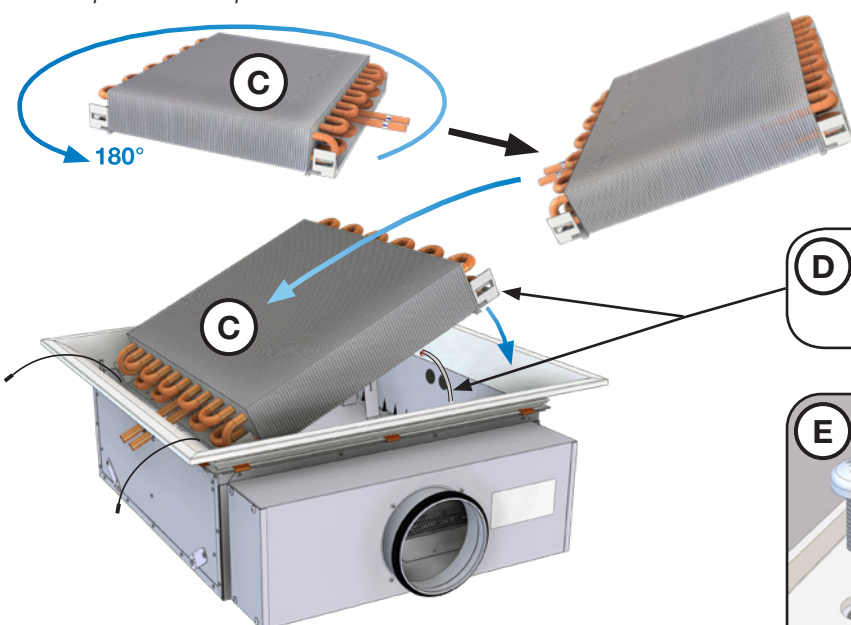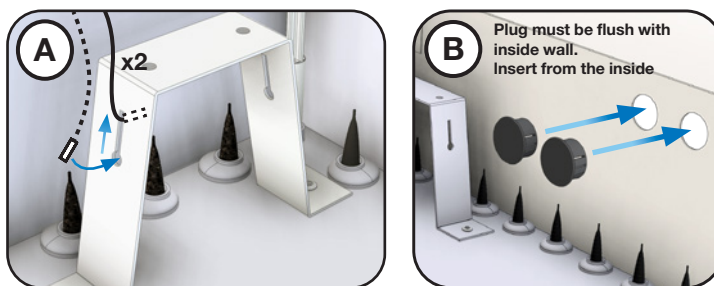

Installation instruction

Plexus

8. Accessories

Ask Lindab for the accessories mentioned in this document. Additional accessories (or additional dimensions) are available on request.**

Order code	Order number
2-way Control valve LinFlow-S-12 straight - push on	686552
2-way Control valve LinFlow-A-12 angled - push on	686554
4 pcs Threaded rod M8 -100mm + 4 pcs z-brackets + 16 pcs screw nuts	on request
4 pcs Threaded rod M8 -500mm + 4 pcs z-brackets + 16 pcs screw nuts	on request
4 pcs Threaded rod M8 -1000mm + 4 pcs z-brackets + 16 pcs screw nuts	on request
Actuator A 40405 24 V on/off NC - 1m, non-halogen cable	684601
Actuator A 41405 24 V on/off NO - 1m, non-halogen cable	684603
Actuator APR 40405 0-10 V mod. NC, 1m, non-halogen cable	684667
Actuator APR 40405 0-10 V mod. NC, 1m, cable	684604
Adapter VA64 M28x1,5	686565
Aerator 12mm - tectite	647690
Ballofix Broen 12 mm with handle - shut-off valve	642663
Ballofix Broen 12 mm without handle - shut-off valve	642662
Copper insert 12 x 1,0 mm	884022
Flexible hose O2stopp_DN10 0,4m - JG12 push - JG12 push	686566
Flexible hose O2stopp_DN10 0,4m - JG12 push - straight end 12 mm	175984
LinCon -12 -15 Water connection set	179040
Lindab PC 410	103344
Regula Combi see: "Accessories"	**
Regula Connect Card Basic	*/**
Regula Connect Card Multi	*/**
Regula Secura	**
Tectite angle 12 mm	884014
Tectite straight 12 mm	884050
Tectite demounting tool 12 mm	884087
Tectite demounting tool 12 mm, small	646881
Touch-up paint RAL 9003 - 25 ml	174759
Touch-up paint RAL 9010 - 25 ml	642531
Transformer 24V AC output	*/**

Table 8. Accessories

* see: "[Regula Connect – What do I get?](#)"

** see: "[Accessories](#)"



Most of us spend the majority of our time indoors. Indoor climate is crucial to how we feel, how productive we are and if we stay healthy.

We at Lindab have therefore made it our most important objective to contribute to an indoor climate that improves people's lives. We do this by developing energy-efficient ventilation solutions and durable building products. We also aim to contribute to a better climate for our planet by working in a way that is sustainable for both people and the environment.

[Lindab](#) | For a better climate